



# The Township of Hamilton

*Jeffrey S. Martin*  
Mayor

## DECK REQUIREMENTS

### PRIOR APPROVALS

1) PRIOR to submitting plans to the Construction Office, a detailed plot plan (to scale) must show the location of the deck, setbacks on front, rear and side yards. The plot plan must also be approved by the Land Use Office. Flood Plan relief must be checked and approved by the Engineering Department. Any approved resolutions or waivers must accompany your plot plan and construction drawings of the deck.

### DECK REQUIREMENTS

- 1) Please submit approved plot plan with signatures from Land Use and Engineering.
- 2) Two (2) sets of construction drawings are required. All drawings should indicate address and owner's signature or sealed architect's drawings.
- 3) If the job is contracted, the contractor must be licensed through the State of New Jersey and must provide a copy of their home improvement license. You may go to the website <https://newjersey.mylicense.com/verification/> to confirm the contractor is licensed.
- 4) A sketch of the deck showing the following must be submitted:
  - a) Top and Side Elevation: Must be detailed with the sizes of materials, guardrails, grippable handrails and footings.
  - b) Footing Detail: Indicate on floor plan all footings locations (including stair footing locations). All footings must extend a minimum of 36" below grade.
  - c) Guardrail and Handrail Detail: Indicate of floor plan height or rails, sizes and types of material and spindle spacing.

**R506.2.2 Base.** A 4-inch-thick (102 mm) base course consisting of clean graded sand, gravel, crushed stone, crushed concrete or crushed blast-furnace slag passing a 2-inch (51 mm) sieve shall be placed on the prepared subgrade where the slab is below *grade*.

**Exception:** A base course is not required where the concrete slab is installed on well-drained or sand-gravel mixture soils classified as Group I according to the United Soil Classification System in accordance with Table R406.1.

**R506.2.3 Vapor retarder.** A minimum 10-mil (0.010 inch; 0.254 mm) vapor retarder conforming to ASTM E1745 Class A requirements with joints lapped not less than 6 inches (152 mm) shall be placed between the concrete floor slab and the base course or the prepared subgrade where a base course does not exist.

**Exception:** The vapor retarder is not required for the following:

1. Garages, utility buildings and other unheated *accessory structures*.
2. For unheated storage rooms having an area of less than 70 square feet (6.5 m<sup>2</sup>) and carports.
3. Driveways, walks, patios and other flatwork not likely to be enclosed and heated at a later date.
4. Where *approved* by the *building official*, based on local site conditions.

**R506.2.4 Reinforcement support.** Where provided in slabs-on-ground, reinforcement shall be supported to remain in place from the center to upper one-third of the slab for the duration of the concrete placement.

## SECTION R507 EXTERIOR DECKS

**R507.1 Decks.** Wood-framed decks shall be in accordance with this section. Decks shall be designed for the *live load* required in Section R301.5 or the ground snow load indicated in Table R301.2, whichever is greater. For decks using materials and conditions not prescribed in this section, refer to Section R301.

**R507.2 Materials.** Materials used for the construction of decks shall comply with this section.

**R507.2.1 Wood materials.** Wood materials shall be No. 2 grade or better lumber, preservative-treated in accordance with Section R317, or *approved*, naturally durable lumber, and termite protected where required in accordance with Section R318. Where design in accordance with Section R301 is provided, wood structural members shall be designed using the wet service factor defined in AWC NDS. Cuts, notches and drilled holes of preservative-treated wood members shall be treated in accordance with Section R317.1.1. All preservative-treated wood products in contact with the ground shall be *labeled* for such usage.

**R507.2.1.1 Engineered wood products.** Engineered wood products shall be in accordance with Section R502.

**R507.2.2 Plastic composite deck boards, stair treads, guards or handrails.** *Plastic composite* exterior deck boards, stair treads, *guards* and *handrails* shall comply with the requirements of ASTM D7032 and this section.

**R507.2.2.1 Labeling.** *Plastic composite* deck boards and stair treads, or their packaging, shall bear a *label* that indicates compliance with ASTM D7032 and includes the allowable load and maximum allowable span determined in accordance with ASTM D7032. *Plastic* or composite *handrails* and *guards*, or their packaging, shall bear a *label* that indicates compliance with ASTM D7032 and includes the maximum allowable span determined in accordance with ASTM D7032.

**R507.2.2.2 Flame spread index.** *Plastic composite* deck boards, stair treads, *guards*, and *handrails* shall exhibit a flame spread index not exceeding 200 when tested in accordance with ASTM E84 or UL 723 with the test specimen remaining in place during the test.

**Exception:** *Plastic composites* determined to be noncombustible.

**R507.2.2.3 Decay resistance.** *Plastic composite* deck boards, stair treads, *guards* and *handrails* containing wood, cellulosic or other biodegradable materials shall be decay resistant in accordance with ASTM D7032.

**R507.2.2.4 Termite resistance.** Where required by Section 318, *plastic composite* deck boards, stair treads, *guards* and *handrails* containing wood, cellulosic or other biodegradable materials shall be termite resistant in accordance with ASTM D7032.

**R507.2.2.5 Installation of plastic composites.** *Plastic composite* deck boards, stair treads, *guards* and *handrails* shall be installed in accordance with this code and the manufacturer's instructions.

**R507.2.3 Fasteners and connectors.** Metal fasteners and connectors used for all decks shall be in accordance with Section R317.3 and Table R507.2.3.

**R507.2.4 Flashing.** Flashing shall be corrosion-resistant metal of nominal thickness not less than 0.019 inch (0.48 mm) or *approved* nonmetallic material that is compatible with the substrate of the structure and the decking materials.

**R507.2.5 Alternate materials.** Alternative materials, including glass and metals, shall be permitted.

**R507.3 Footings.** Decks shall be supported on concrete footings or other *approved* structural systems designed to accommodate all loads in accordance with Section R301. Deck footings shall be sized to carry the imposed loads from the deck structure to the ground as shown in Figure R507.3.

**Exceptions:**

1. Footings shall not be required for free-standing decks consisting of joists directly supported on grade over their entire length.

2. Footings shall not be required for free-standing decks that meet all of the following criteria:
  - 2.1. The joists bear directly on *precast concrete* pier blocks at grade without support by beams or posts.
  - 2.2. The area of the deck does not exceed 200 square feet (18.6 m<sup>2</sup>).
  - 2.3. The walking surface is not more than 20 inches (508 mm) above grade at any point within 36 inches (914 mm) measured horizontally from the edge.

**R507.3.1 Minimum size.** The minimum size of concrete footings shall be in accordance with Table R507.3.1, based on the tributary area and allowable soil-bearing pressure in accordance with Table R401.4.1.

**R507.3.2 Minimum depth.** Deck footings shall be placed not less than 12 inches (305 mm) below the undisturbed ground surface.

**R507.3.3 Frost protection.** Where decks are attached to a frost-protected structure, deck footings shall be protected from frost by one or more of the following methods:

1. Extending below the frost line specified in Table R301.2.
2. Erecting on solid rock.
3. Other *approved* methods of frost protection.


**R507.4 Deck posts.** For single-level decks, wood post size shall be in accordance with Table R507.4.

**TABLE R507.2.3**  
**FASTENER AND CONNECTOR SPECIFICATIONS FOR DECKS<sup>a, b</sup>**

ITEM	MATERIAL	MINIMUM FINISH/COATING	ALTERNATE FINISH/COATING <sup>c</sup>
Nails and glulam rivets	In accordance with ASTM F1667	Hot-dipped galvanized per ASTM A153, Class D for 3/8-inch diameter and less	Stainless steel, silicon bronze or copper
Bolts <sup>c</sup> Lag screws <sup>d</sup> (including nuts and washers)	In accordance with ASTM A307 (bolts), ASTM A563 (nuts), ASTM F844 (washers)	Hot-dipped galvanized per ASTM A153, Class C (Class D for 3/8-inch diameter and less) or mechanically galvanized per ASTM B695, Class 55 or 410 stainless steel	Stainless steel, silicon bronze or copper
Metal connectors	Per manufacturer's specification	ASTM A653 type G185 zinc-coated galvanized steel or post hot-dipped galvanized per ASTM A123 providing a minimum average coating weight of 2.0 oz./ft <sup>2</sup> (total both sides)	Stainless steel

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

- a. Equivalent materials, coatings and finishes shall be permitted.
- b. Fasteners and connectors exposed to salt water or located within 300 feet of a salt water shoreline shall be stainless steel.
- c. Holes for bolts shall be drilled a minimum 1/32 inch and a maximum 1/16 inch larger than the bolt.
- d. Lag screws 1/2 inch and larger shall be predrilled to avoid wood splitting per the *National Design Specification (NDS) for Wood Construction*.
- e. Stainless-steel-driven fasteners shall be in accordance with ASTM F1667.

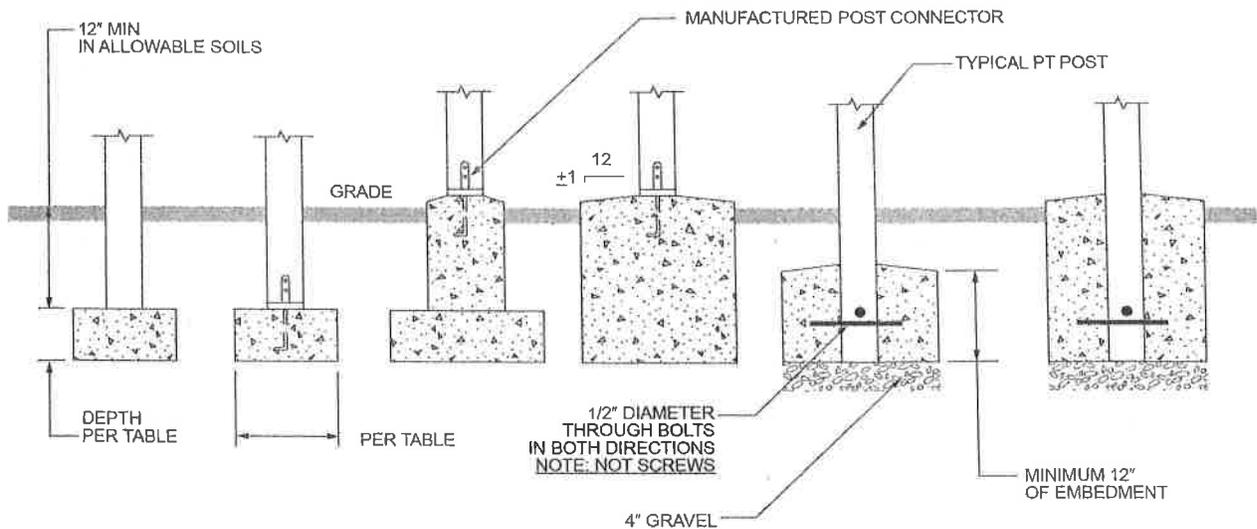

NOTE:  
POSTS MUST BE CENTERED ON OR IN FOOTING

For SI: 1 inch = 25.4 mm.

**FIGURE R507.3**  
**DECK POSTS TO DECK FOOTING CONNECTION**

**TABLE R507.3.1  
MINIMUM FOOTING SIZE FOR DECKS**

LIVE OR GROUND SNOW LOAD <sup>b</sup> (psf)	TRIBUTARY AREA (ft <sup>2</sup> )	LOAD-BEARING VALUE OF SOILS <sup>a, c, d</sup> (psf)								
		1,500 <sup>a</sup>			2,000 <sup>a</sup>			≥ 3,000 <sup>a</sup>		
		Side of a square footing (inches)	Diameter of a round footing (inches)	Thickness (inches) <sup>f</sup>	Side of a square footing (Inches)	Diameter of a round footing (inches)	Thickness (inches) <sup>f</sup>	Side of a square footing (inches)	Diameter of a round footing (inches)	Thickness (inches) <sup>f</sup>
40	5	7	8	6	7	8	6	7	8	6
	20	10	12	6	9	9	6	7	8	6
	40	14	16	6	12	14	6	10	12	6
	60	17	19	6	15	17	6	12	14	6
	80	20	22	7	17	19	6	14	16	6
	100	22	25	8	19	21	6	15	17	6
	120	24	27	9	21	23	7	17	19	6
	140	26	29	10	22	25	8	18	21	6
50	5	7	8	6	7	8	6	7	8	6
	20	11	13	6	10	11	6	8	9	6
	40	15	17	6	13	15	6	11	13	6
	60	19	21	6	16	18	6	13	15	6
	80	21	24	8	19	21	6	15	17	6
	100	24	27	9	21	23	7	17	19	6
	120	26	30	10	23	26	8	19	21	6
	140	28	32	11	25	28	9	20	23	7
60	5	7	8	6	7	8	6	7	8	6
	20	12	14	6	11	12	6	9	10	6
	40	16	19	6	14	16	8	12	14	6
	60	20	23	7	17	20	6	14	16	6
	80	23	26	9	20	23	7	16	19	6
	100	26	29	10	22	25	8	18	21	6
	120	28	32	11	25	28	9	20	23	7
	140	31	35	12	27	30	10	22	24	8
70	5	7	8	6	7	8	6	7	8	6
	20	12	14	6	11	13	6	9	10	6
	40	18	20	6	15	17	6	12	14	6
	60	21	24	8	19	21	6	15	17	6
	80	25	28	9	21	24	8	18	20	6
	100	28	31	11	24	27	9	20	22	7
	120	30	34	12	26	30	10	21	24	8
	140	33	37	13	28	32	11	23	26	9
160	35	40	15	30	34	12	25	28	9	

For SI: 1 inch = 25.4 mm, 1 square foot = 0.0929 m<sup>2</sup>, 1 pound per square foot = 0.0479 kPa.

- a. Interpolation permitted, extrapolation not permitted.
- b. Based on highest load case: Dead + Live or Dead + Snow.
- c. Footing dimensions shall allow complete bearing of the post.
- d. If the support is a brick or CMU pier, the footing shall have a minimum 2-inch projection on all sides.
- e. Area, in square feet, of deck surface supported by post and footings.
- f. Minimum thickness shall only apply to plain concrete footings.

FLOORS

TABLE R507.4  
DECK POST HEIGHT

LOADS (psf) <sup>b</sup>	POST SPECIES <sup>c</sup>	POST SIZE <sup>d</sup>	TRIBUTARY AREA (ft <sup>2</sup> ) <sup>e, h</sup>							
			20	40	60	80	100	120	140	160
			MAXIMUM DECK POST HEIGHT <sup>a</sup> (feet-inches)							
40 live load	Southern pine	4 × 4	14-0	13-8	11-0	9-5	8-4	7-5	6-9	6-2
		4 × 6	14-0	14-0	13-11	12-0	10-8	9-8	8-10	8-2
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Douglas fir <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	4 × 4	14-0	13-6	10-10	9-3	8-0	7-0	6-2	5-3
		4 × 6	14-0	14-0	13-10	11-10	10-6	9-5	8-7	7-10
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	4 × 4	14-0	13-2	10-3	8-1	5-8	NP <sup>g</sup>	NP <sup>g</sup>	NP <sup>g</sup>
		4 × 6	14-0	14-0	13-6	11-4	9-9	8-4	6-9	4-7
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	13-7	9-7
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
50 ground snow load	Southern pine	4 × 4	14-0	12-2	9-10	8-5	7-5	6-7	5-11	5-4
		4 × 6	14-0	14-0	12-6	10-9	9-6	8-7	7-10	7-3
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	14-0	13-4
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Douglas fir <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	4 × 4	14-0	12-1	9-8	8-2	7-1	6-2	5-3	4-2
		4 × 6	14-0	14-0	12-4	10-7	9-4	8-4	7-7	6-11
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	14-0	12-10
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	4 × 4	14-0	11-8	9-0	6-10	3-7	NP <sup>g</sup>	NP <sup>g</sup>	NP <sup>g</sup>
		4 × 6	14-0	14-0	12-0	10-0	8-6	7-0	5-3	NP <sup>g</sup>
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	10-8	2-4
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
60 ground snow load	Southern pine	4 × 4	14-0	11-1	8-11	7-7	6-7	5-10	5-2	4-6
		4 × 6	14-0	14-0	11-4	9-9	8-7	7-9	7-1	6-6
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	12-9	11-2
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Douglas fir <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	4 × 4	14-0	10-11	8-8	7-3	6-2	5-0	3-7	NP <sup>g</sup>
		4 × 6	14-0	13-11	11-2	9-7	8-4	7-5	6-8	5-11
		6 × 6	14-0	14-0	14-0	14-0	14-0	14-0	12-2	10-2
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	4 × 4	14-0	10-6	7-9	4-7	NP <sup>g</sup>	NP <sup>g</sup>	NP <sup>g</sup>	NP <sup>g</sup>
		4 × 6	14-0	13-7	10-9	8-9	7-0	4-9	NP <sup>g</sup>	NP <sup>g</sup>
		6 × 6	14-0	14-0	14-0	14-0	14-0	9-9	NP <sup>g</sup>	NP <sup>g</sup>
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0

(continued)

TABLE R507.4—continued  
DECK POST HEIGHT

LOADS (psf) <sup>b</sup>	POST SPECIES <sup>c</sup>	POST SIZE <sup>d</sup>	TRIBUTARY AREA (ft <sup>2</sup> ) <sup>g,h</sup>							
			20	40	60	80	100	120	140	160
			MAXIMUM DECK POST HEIGHT <sup>e</sup> (feet-inches)							
70 ground snow load	Southern pine	4 × 4	14-0	10-2	8-2	6-11	5-11	5-2	4-4	3-4
		4 × 6	14-0	12-11	10-5	8-11	7-10	7-1	6-5	5-10
		6 × 6	14-0	14-0	14-0	14-0	14-0	12-9	10-11	8-7
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Douglas fir <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	4 × 4	14-0	10-1	7-11	6-6	5-3	3-7	NP	NP
		4 × 6	14-0	12-10	10-3	8-9	7-7	6-8	5-10	4-11
		6 × 6	14-0	14-0	14-0	14-0	14-0	12-2	9-9	5-9
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	4 × 4	14-0	9-5	6-5	NP	NP	NP	NP	NP
		4 × 6	14-0	12-6	9-8	7-7	5-3	NP	NP	NP
		6 × 6	14-0	14-0	14-0	14-0	10-8	NP	NP	NP
		8 × 8	14-0	14-0	14-0	14-0	14-0	14-0	14-0	14-0

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa.

NP = Not Permitted.

- a. Measured from the underside of the beam to the top of footing or pier.
- b. 10 psf dead load. Snow load not assumed to be concurrent with live load.
- c. No. 2 grade, wet service factor included.
- d. Notched deck posts shall be sized to accommodate beam size in accordance with Section R507.5.2.
- e. Includes incising factor.
- f. Incising factor not included.
- g. Area, in square feet, of deck surface supported by post and footings.
- h. Interpolation permitted. Extrapolation not permitted.

**R507.4.1 Deck post to deck footing connection.** Where posts bear on concrete footings in accordance with Section R403 and Figure R507.3, lateral restraint shall be provided by manufactured connectors or a minimum post embedment of 12 inches (305 mm) in surrounding soils or concrete piers. Other footing systems shall be permitted.

**Exception:** Where expansive, compressible, shifting or other questionable soils are present, surrounding soils shall not be relied on for lateral support.

**R507.5 Deck beams.** Maximum allowable spans for wood deck beams, as shown in Figure R507.5, shall be in accordance with Tables R507.5(1) through R507.5(4). Beam plies shall be fastened together with two rows of 10d (3-inch × 0.128-inch) nails minimum at 16 inches (406 mm) on center along each edge. Beams shall be permitted to cantilever at each end up to one-fourth of the actual beam span. Deck beams of other materials shall be permitted where designed in accordance with accepted engineering practices.

**R507.5.1 Deck beam bearing.** The ends of beams shall have not less than 1½ inches (38 mm) of bearing on wood or metal and not less than 3 inches (76 mm) of bearing on concrete or masonry for the entire width of the beam. Where multiple-span beams bear on intermediate posts, each ply must have full bearing on the post in accordance with Figures R507.5.1(1) and R507.5.1(2).

**R507.5.2 Deck beam connection to supports.** Deck beams shall be attached to supports in a manner capable of

transferring vertical loads and resisting horizontal displacement. Deck beam connections to wood posts shall be in accordance with Figures R507.5.1(1) and R507.5.1(2). Manufactured post-to-beam connectors shall be sized for the post and beam sizes. Bolts shall have washers under the head and nut.

**R507.6 Deck joists.** Maximum allowable spans for wood deck joists, as shown in Figure R507.6, shall be in accordance with Table R507.6. The maximum joist spacing shall be limited by the decking materials in accordance with Table R507.7.

**R507.6.1 Deck joist bearing.** The ends of joists shall have not less than 1½ inches (38 mm) of bearing on wood or metal and not less than 3 inches (76 mm) of bearing on concrete or masonry over its entire width. Joists bearing on top of a multiple-ply beam or ledger shall be fastened in accordance with Table R602.3(1). Joists bearing on top of a single-ply beam or ledger shall be attached by a mechanical connector. Joist framing into the side of a beam or ledger board shall be supported by approved joist hangers.

**R507.6.2 Deck joist lateral restraint.** Joist ends and bearing locations shall be provided with lateral resistance to prevent rotation. Where lateral restraint is provided by joist hangers or blocking between joists, their depth shall equal not less than 60 percent of the joist depth. Where lateral restraint is provided by rim joists, they shall be

## FLOORS

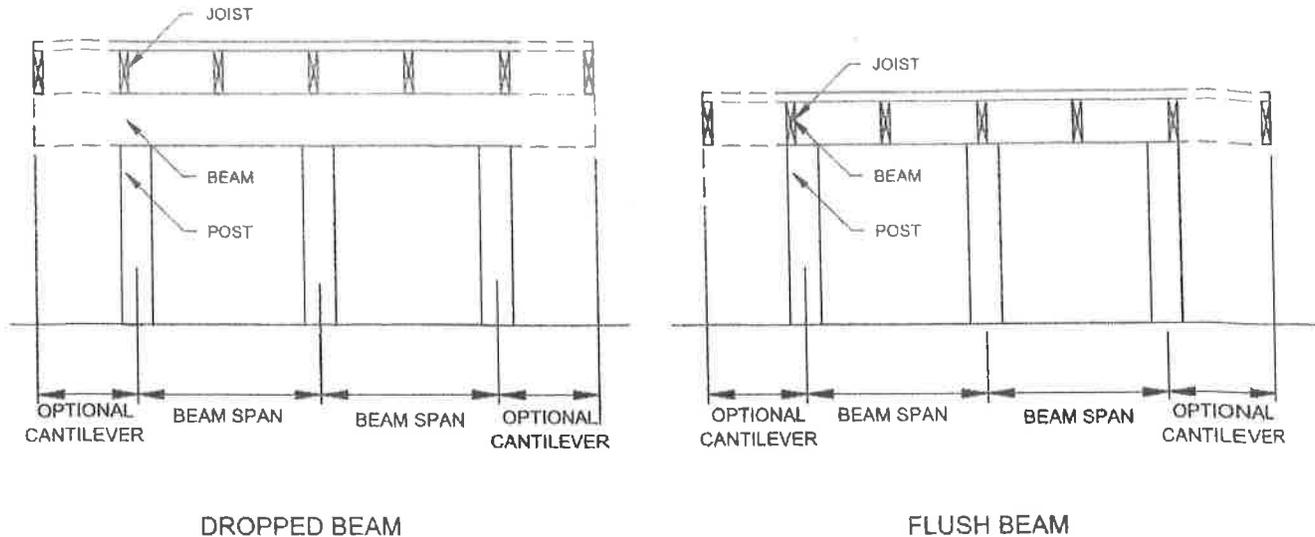


FIGURE R507.5  
TYPICAL DECK JOIST SPANS

secured to the end of each joist with not fewer than three 10d (3-inch by 0.128-inch) (76 mm by 3.3 mm) nails or three No. 10 x 3-inch-long (76 mm) wood screws.

**R507.7 Decking.** Maximum allowable spacing for joists supporting wood decking, excluding stairways, shall be in accordance with Table R507.7. Wood decking shall be attached to each supporting member with not less than two 8d threaded nails or two No. 8 wood screws. Maximum allowable spacing for joists supporting plastic composite decking shall be in accordance with Section R507.2. Other approved decking or fastener systems shall be installed in accordance with the manufacturer's installation requirements.

**R507.8 Vertical and lateral supports.** Where supported by attachment to an exterior wall, decks shall be positively anchored to the primary structure and designed for both vertical and lateral loads. Such attachment shall not be accomplished by the use of toenails or nails subject to withdrawal. For decks with cantilevered framing members, connection to exterior walls or other framing members shall be designed and constructed to resist uplift resulting from the full live load specified in Table R301.5 acting on the cantilevered portion of the deck. Where positive connection to the primary building structure cannot be verified during inspection, decks shall be self-supporting.

**R507.9 Vertical and lateral supports at band joist.** Vertical and lateral supports for decks shall comply with this section.

**R507.9.1 Vertical supports.** Vertical loads shall be transferred to band joists with ledgers in accordance with this section.

**R507.9.1.1 Ledger details.** Deck ledgers shall be a minimum 2-inch by 8-inch (51 mm by 203 mm) nominal, pressure-preservative-treated Southern pine, incised pressure-preservative-treated hem-fir, or approved, naturally durable, No. 2 grade or better lumber. Deck ledgers shall not support concentrated loads from beams or girders. Deck ledgers shall not be supported on stone or masonry veneer.

**R507.9.1.2 Band joist details.** Band joists supporting a ledger shall be a minimum 2-inch-nominal (51 mm), solid-sawn, spruce-pine-fir or better lumber or a minimum 1-inch (25 mm) nominal engineered wood rim boards in accordance with Section R502.1.7. Band joists shall bear fully on the primary structure capable of supporting all required loads.

**R507.9.1.3 Ledger to band joist details.** Fasteners used in deck ledger connections in accordance with Table R507.9.1.3(1) shall be hot-dipped galvanized or stainless steel and shall be installed in accordance with Table R507.9.1.3(2) and Figures R507.9.1.3(1) and R507.9.1.3(2).

**R507.9.1.4 Alternate ledger details.** Alternate framing configurations supporting a ledger constructed to meet the load requirements of Section R301.5 shall be permitted.

**TABLE R507.5(1)**  
**MAXIMUM DECK BEAM SPAN—40 PSF LIVE LOAD<sup>c</sup>**

BEAM SPECIES <sup>d</sup>	BEAM SIZE <sup>e</sup>	EFFECTIVE DECK JOIST SPAN LENGTH <sup>a, i, j</sup> (feet)						
		6	8	10	12	14	16	18
		MAXIMUM DECK BEAM SPAN LENGTH (feet-Inches) <sup>a, b, f</sup>						
Southern pine	1-2 x 6	4-7	4-0	3-7	3-3	3-0	2-10	2-8
	1-2 x 8	5-11	5-1	4-7	4-2	3-10	3-7	3-5
	1-2 x 10	7-0	6-0	5-5	4-11	4-7	4-3	4-0
	1-2 x 12	8-3	7-1	6-4	5-10	5-5	5-0	4-9
	2-2 x 6	6-11	5-11	5-4	4-10	4-6	4-3	4-0
	2-2 x 8	8-9	7-7	6-9	6-2	5-9	5-4	5-0
	2-2 x 10	10-4	9-0	8-0	7-4	6-9	6-4	6-0
	2-2 x 12	12-2	10-7	9-5	8-7	8-0	7-5	7-0
	3-2 x 6	8-6	7-5	6-8	6-1	5-8	5-3	4-11
	3-2 x 8	10-11	9-6	8-6	7-9	7-2	6-8	6-4
	3-2 x 10	13-0	11-2	10-0	9-2	8-6	7-11	7-6
3-2 x 12	15-3	13-3	11-10	10-9	10-0	9-4	8-10	
Douglas fir-larch <sup>g</sup> Hem-fir <sup>g</sup> Spruce-pine-fir	1-2 x 6	4-1	3-6	3-0	2-8	2-5	2-3	2-1
	1-2 x 8	5-6	4-8	4-0	3-6	3-2	2-11	2-9
	1-2 x 10	6-8	5-10	5-1	4-6	4-1	3-9	3-6
	1-2 x 12	7-9	6-9	6-0	5-6	5-0	3-9	3-6
	2-2 x 6	6-1	5-3	4-9	4-4	3-11	3-7	3-3
	2-2 x 8	8-2	7-1	6-4	5-9	5-2	4-8	4-4
	2-2 x 10	10-0	8-7	7-9	7-0	6-6	6-0	5-6
	2-2 x 12	11-7	10-0	8-11	8-2	7-7	7-1	6-8
	3-2 x 6	7-8	6-8	6-0	5-6	5-1	4-9	4-6
	3-2 x 8	10-3	8-10	7-11	7-3	6-8	6-3	5-11
	3-2 x 10	12-6	10-10	9-8	8-10	8-2	7-8	7-2
3-2 x 12	14-6	12-7	11-3	10-3	9-6	8-11	8-5	
Redwood <sup>h</sup> Western cedars <sup>h</sup> Ponderosa pine <sup>h</sup> Red pine <sup>h</sup>	1-2 x 6	4-2	3-7	3-1	2-9	2-6	2-3	2-2
	1-2 x 8	5-4	4-7	4-1	3-7	3-3	3-0	2-10
	1-2 x 10	6-6	5-7	5-0	4-7	4-2	3-10	3-7
	1-2 x 12	7-6	6-6	5-10	5-4	4-11	4-7	4-4
	2-2 x 6	6-2	5-4	4-10	4-5	4-0	3-8	3-4
	2-2 x 8	7-10	6-10	6-1	5-7	5-2	4-10	4-5
	2-2 x 10	9-7	8-4	7-5	6-9	6-3	5-10	5-6
	2-2 x 12	11-1	9-8	8-7	7-10	7-3	6-10	6-5
	3-2 x 6	7-8	6-9	6-0	5-6	5-1	4-9	4-6
	3-2 x 8	9-10	8-6	7-7	6-11	6-5	6-0	5-8
	3-2 x 10	12-0	10-5	9-4	8-6	7-10	7-4	6-11
3-2 x 12	13-11	12-1	10-9	9-10	9-1	8-6	8-1	

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 pound = 0.454 kg.

a. Interpolation permitted. Extrapolation not permitted.

b. Beams supporting a single span of joists with or without cantilever.

c. Dead load = 10 psf,  $L/\Delta = 360$  at main span,  $L/\Delta = 180$  at cantilever. Snow load is not assumed to be concurrent with live load.

d. No. 2 grade, wet service factor included.

e. Beam depth shall be equal to or greater than the depth of intersecting joist for a flush beam connection.

f. Beam cantilevers are limited to the adjacent beam's span divided by 4.

g. Includes incising factor.

h. Incising factor not included.

i. Deck joist span as shown in Figure R507.5.

j. For calculation of effective deck joist span, the actual joist span length shall be multiplied by the joist span factor in accordance with Table R507.5(5).

FLOORS

TABLE R507.5(2)  
MAXIMUM DECK BEAM SPAN—50 PSF GROUND SNOW LOAD<sup>c</sup>

BEAM SPECIES <sup>d</sup>	BEAM SIZE <sup>e</sup>	EFFECTIVE DECK JOIST SPAN LENGTH (feet) <sup>a, i, j</sup>						
		6	8	10	12	14	16	18
		MAXIMUM DECK BEAM SPAN LENGTH (feet-inches) <sup>a, b, f</sup>						
Southern pine	1-2 x 6	4-6	3-11	3-6	3-2	2-11	2-9	2-7
	1-2 x 8	5-9	4-11	4-5	4-0	3-9	3-6	3-3
	1-2 x 10	6-9	5-10	5-3	4-9	4-5	4-2	3-11
	1-2 x 12	8-0	6-11	6-2	5-8	5-3	4-11	4-7
	2-2 x 6	6-8	5-9	5-2	4-9	4-4	4-1	3-10
	2-2 x 8	8-6	7-4	6-7	6-0	5-7	5-2	4-11
	2-2 x 10	10-1	8-9	7-10	7-1	6-7	6-2	5-10
	2-2 x 12	11-11	10-3	9-2	8-5	7-9	7-3	6-10
	3-2 x 6	7-11	7-2	6-6	5-11	5-6	5-1	4-10
	3-2 x 8	10-5	9-3	8-3	7-6	6-11	6-6	6-2
	3-2 x 10	12-8	10-11	9-9	8-11	8-3	7-9	7-3
3-2 x 12	14-11	12-11	11-6	10-6	9-9	9-1	8-7	
Douglas fir-larch <sup>g</sup> Hem-fir <sup>g</sup> Spruce-pine-fir <sup>g</sup>	1-2 x 6	4-0	3-5	2-11	2-7	2-4	2-2	2-0
	1-2 x 8	5-4	4-7	3-11	3-5	3-1	2-10	2-8
	1-2 x 10	6-7	5-8	4-11	4-5	4-0	3-8	3-5
	1-2 x 12	7-7	6-7	5-11	5-4	4-10	4-6	4-2
	2-2 x 6	6-0	5-2	4-7	4-2	3-10	3-5	3-2
	2-2 x 8	8-0	6-11	6-2	5-8	5-0	4-7	4-2
	2-2 x 10	9-9	8-5	7-7	6-11	6-4	5-10	5-4
	2-2 x 12	11-4	9-10	8-9	8-0	7-5	6-11	6-6
	3-2 x 6	7-6	6-6	5-9	5-3	4-11	4-7	4-4
	3-2 x 8	10-0	8-8	7-9	7-1	6-6	6-1	5-8
	3-2 x 10	12-3	10-7	9-6	8-8	8-0	7-6	7-0
3-2 x 12	14-3	12-4	11-0	10-1	9-4	8-9	8-3	
Redwood <sup>h</sup> Western cedars <sup>h</sup> Ponderosa pine <sup>h</sup> Red pine <sup>h</sup>	1-2 x 6	4-1	3-6	3-0	2-8	2-5	2-3	2-1
	1-2 x 8	5-2	4-6	4-0	3-6	3-2	2-11	2-9
	1-2 x 10	6-4	5-6	4-11	4-6	4-1	3-9	3-6
	1-2 x 12	7-4	6-4	5-8	5-2	4-10	4-6	4-3
	2-2 x 6	6-1	5-3	4-8	4-4	3-11	3-6	3-3
	2-2 x 8	7-8	6-8	5-11	5-5	5-0	4-8	4-3
	2-2 x 10	9-5	8-2	7-3	6-8	6-2	5-9	5-5
	2-2 x 12	10-11	9-5	8-5	7-8	7-2	6-8	6-3
	3-2 x 6	7-1	6-5	5-11	5-5	5-0	4-8	4-5
	3-2 x 8	9-4	8-4	7-5	6-10	6-0	5-11	5-7
	3-2 x 10	11-9	10-2	9-1	8-4	7-8	7-2	6-9
3-2 x 12	13-8	11-10	10-7	9-8	8-11	8-4	7-10	

For SI: 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 pound = 0.454 kg.

- a. Interpolation allowed. Extrapolation is not allowed.
- b. Beams supporting a single span of joists with or without cantilever.
- c. Dead load = 10 psf,  $L/\Delta = 360$  at main span,  $L/\Delta = 180$  at cantilever. Snow load not assumed to be concurrent with live load.
- d. No. 2 grade, wet service factor included.
- e. Beam depth shall be equal to or greater than the depth of intersecting joist for a flush beam connection.
- f. Beam cantilevers are limited to the adjacent beam's span divided by 4.
- g. Includes incising factor.
- h. Incising factor not included.
- i. Deck joist span as shown in Figure R507.5.
- j. For calculation of effective deck joist span, the actual joist span length shall be multiplied by the joist span factor in accordance with Table R507.5(5).

**TABLE R507.5(3)**  
**MAXIMUM DECK BEAM SPAN—60 PSF GROUND SNOW LOAD<sup>c</sup>**

BEAM SPECIES <sup>d</sup>	BEAM SIZE <sup>e</sup>	EFFECTIVE DECK JOIST SPAN LENGTH <sup>a, j</sup> (feet)						
		6	8	10	12	14	16	18
		MAXIMUM DECK BEAM SPAN LENGTH (feet-inches) <sup>a, b, f</sup>						
Southern pine	1-2 x 6	4-2	3-7	3-3	2-11	2-9	2-6	2-5
	1-2 x 8	5-3	4-7	4-1	3-9	3-5	3-3	3-0
	1-2 x 10	6-3	5-5	4-10	4-5	4-1	3-10	3-7
	1-2 x 12	7-5	6-5	5-9	5-3	4-10	4-6	4-3
	2-2 x 6	6-2	5-4	4-9	4-4	4-0	3-9	3-7
	2-2 x 8	7-10	6-10	6-1	5-7	5-2	4-10	4-6
	2-2 x 10	9-4	8-1	7-3	6-7	6-1	5-8	5-4
	2-2 x 12	11-0	9-6	8-6	7-9	7-2	6-9	6-4
	3-2 x 6	7-5	6-9	6-0	5-6	5-1	4-9	4-6
	3-2 x 8	9-9	8-6	7-8	6-11	6-5	6-0	5-8
	3-2 x 10	11-8	10-2	9-1	8-3	7-8	7-2	6-9
3-2 x 12	13-9	11-11	10-8	9-9	9-0	8-5	7-11	
Douglas fir-larch <sup>g</sup> Hem-fir <sup>g</sup> Spruce-pine-fir <sup>g</sup>	1-2 x 6	3-8	3-1	2-8	2-4	2-2	2-0	1-10
	1-2 x 8	5-0	4-1	3-6	3-1	2-10	2-7	2-5
	1-2 x 10	6-1	5-2	4-6	4-0	3-7	3-4	3-2
	1-2 x 12	7-1	6-1	5-5	4-10	4-5	4-1	3-10
	2-2 x 6	5-6	4-9	4-3	3-10	3-5	3-1	2-10
	2-2 x 8	7-5	6-5	5-9	5-0	4-6	4-1	3-9
	2-2 x 10	9-0	7-10	7-0	6-4	5-9	5-2	4-10
2-2 x 12	10-6	9-1	8-1	7-5	6-10	6-4	5-10	
	3-2 x 6	6-11	6-0	5-4	4-11	4-6	4-2	3-10
	3-2 x 8	9-3	8-0	7-2	6-6	6-1	5-6	5-0
	3-2 x 10	11-4	9-10	8-9	8-0	7-5	6-11	6-5
	3-2 x 12	13-2	11-5	10-2	9-4	8-7	8-1	7-7
Redwood <sup>h</sup> Western cedars <sup>h</sup> Ponderosa pine <sup>h</sup> Red pine <sup>h</sup>	1-2 x 6	3-9	3-2	2-9	2-5	2-2	2-0	1-11
	1-2 x 8	4-10	4-2	3-7	3-2	2-11	2-8	2-6
	1-2 x 10	5-10	5-1	4-6	4-1	3-8	3-5	3-3
	1-2 x 12	6-10	5-11	5-3	4-10	4-5	4-2	3-11
	2-2 x 6	5-7	4-10	4-4	3-11	3-6	3-2	2-11
	2-2 x 8	7-1	6-2	5-6	5-0	4-7	4-2	3-10
	2-2 x 10	8-8	7-6	6-9	6-2	5-8	5-4	4-11
	2-2 x 12	10-1	8-9	7-10	7-2	6-7	6-2	5-10
	3-2 x 6	6-8	6-1	5-5	5-0	4-7	4-3	3-11
	3-2 x 8	8-9	7-9	6-22	6-4	5-20	5-5	5-3
	3-2 x 10	10-11	9-5	8-5	7-8	7-3	6-8	6-3
3-2 x 12	12-8	10-11	9-9	8-11	8-3	7-9	7-3	

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 pound = 0.454 kg.

a. Interpolation allowed. Extrapolation is not allowed.

b. Beams supporting a single span of joists with or without cantilever.

c. Dead load = 10 psf,  $L/\Delta = 360$  at main span,  $L/\Delta = 180$  at cantilever. Snow load not assumed to be concurrent with live load.

d. No. 2 grade, wet service factor included.

e. Beam depth shall be equal to or greater than the depth of intersecting joist for a flush beam connection.

f. Beam cantilevers are limited to the adjacent beam's span divided by 4.

g. Includes incising factor.

h. Incising factor not included.

i. Deck joist span as shown in Figure R507.5.

j. For calculation of effective deck joist span, the actual joist span length shall be multiplied by the joist span factor in accordance with Table R507.5(5).

FLOORS

TABLE R507.5(4)  
MAXIMUM DECK BEAM SPAN—70 PSF GROUND SNOW LOAD<sup>c</sup>

BEAM SPECIES <sup>a</sup>	BEAM SIZE <sup>a</sup>	EFFECTIVE DECK JOIST SPAN LENGTH (feet) <sup>a, h, i</sup>						
		6	8	10	12	14	16	18
		MAXIMUM DECK BEAM SPAN LENGTH (feet-inches) <sup>a, b, f</sup>						
Southern pine	1-2 x 6	3-11	3-4	3-0	2-9	2-6	2-4	2-3
	1-2 x 8	4-11	4-3	3-10	3-6	3-3	3-0	2-10
	1-2 x 10	5-10	5-1	4-6	4-2	3-10	3-7	3-4
	1-2 x 12	6-11	6-0	5-4	4-11	4-6	4-3	4-0
	2-2 x 6	5-9	5-0	4-6	4-1	3-9	3-6	3-4
	2-2 x 8	7-4	6-4	5-8	5-2	4-10	4-6	4-3
	2-2 x 10	8-9	7-7	6-9	6-2	5-8	5-4	5-0
	2-2 x 12	10-3	8-11	8-0	7-3	6-9	6-3	5-11
	3-2 x 6	7-0	6-3	5-7	5-1	4-9	4-5	4-2
	3-2 x 8	9-3	8-0	7-2	6-6	6-0	5-8	5-4
	3-2 x 10	10-11	9-6	8-6	7-9	7-2	6-8	6-4
3-2 x 12	12-11	11-2	10-0	9-1	8-5	7-11	7-5	
Douglas fir-larch <sup>g</sup> Hem-fir <sup>g</sup> Spruce-pine-fir <sup>g</sup>	1-2 x 6	3-5	2-10	2-5	2-2	2-0	1-10	1-9
	1-2 x 8	4-7	3-8	3-2	2-10	2-7	2-5	2-4
	1-2 x 10	5-8	4-9	4-1	3-8	3-4	3-1	2-11
	1-2 x 12	6-7	5-8	5-0	4-6	4-1	3-10	3-7
	2-2 x 6	5-2	4-6	4-0	3-5	3-1	2-10	2-7
	2-2 x 8	6-11	6-0	5-3	4-7	4-1	3-8	3-5
	2-2 x 10	8-5	7-4	6-6	5-10	5-2	4-9	4-5
	2-2 x 12	9-10	8-6	7-7	6-11	6-4	5-9	5-4
	3-2 x 6	6-6	5-7	5-0	4-7	4-2	3-9	3-5
	3-2 x 8	8-8	7-6	6-8	6-1	5-6	5-0	4-7
	3-2 x 10	10-7	9-2	8-2	7-6	6-11	6-4	5-10
3-2 x 12	12-4	10-8	9-7	8-9	8-1	7-7	7-1	
Redwood <sup>h</sup> Western cedars <sup>h</sup> Ponderosa pine <sup>h</sup> Red pine <sup>h</sup>	1-2 x 6	3-6	2-11	2-6	2-3	2-0	1-11	1-9
	1-2 x 8	4-6	3-10	3-3	2-11	2-8	2-6	2-4
	1-2 x 10	5-6	4-9	4-2	3-9	3-5	3-2	3-0
	1-2 x 12	6-4	5-6	4-11	4-6	4-2	3-11	3-8
	2-2 x 6	5-3	4-7	4-1	3-6	3-2	2-11	2-8
	2-2 x 8	6-8	5-9	5-2	4-8	4-2	3-10	3-6
	2-2 x 10	8-2	7-1	6-4	5-9	5-4	4-10	4-6
	2-2 x 12	9-5	8-2	7-4	6-8	6-2	5-9	5-5
	3-2 x 6	6-4	5-8	5-1	4-8	4-3	3-10	3-6
	3-2 x 8	8-4	7-3	6-5	5-11	5-5	5-1	4-8
	3-2 x 10	10-2	8-10	7-11	7-2	6-8	6-3	5-11
3-2 x 12	11-10	10-3	9-2	8-4	7-9	7-3	6-10	

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 pound = 0.454 kg.


- a. Interpolation allowed. Extrapolation is not allowed.
- b. Beams supporting a single span of joists with or without cantilever.
- c. Dead load = 10 psf,  $L/\Delta = 360$  at main span,  $L/\Delta = 180$  at cantilever. Snow load not assumed to be concurrent with live load.
- d. No. 2 grade, wet service factor included.
- e. Beam depth shall be equal to or greater than the depth of intersecting joist for a flush beam connection.
- f. Beam cantilevers are limited to the adjacent beam's span divided by 4.
- g. Includes incising factor.
- h. Incising factor not included.
- i. Deck joist span as shown in Figure R507.5.
- j. For calculation of effective deck joist span, the actual joist span length shall be multiplied by the joist span factor in accordance with Table R507.5(5).

**TABLE R507.5(5)**  
**JOIST SPAN FACTORS FOR CALCULATING EFFECTIVE DECK JOIST SPAN**  
 [for use with Note j in Tables R507.5(1), R507.5(2), R507.5(3) and R507.5(4)]

C/J*	JOIST SPAN FACTOR
0 (no cantilever)	0.66
1/12 (0.87)	0.72
1/10 (0.10)	0.80
1/8 (0.125)	0.84
1/6 (0.167)	0.90
1/4 (0.250)	1.00

For SI: 1 foot = 304.8 mm.


a. C = actual joist cantilever length (feet); J = actual joist span length (feet).

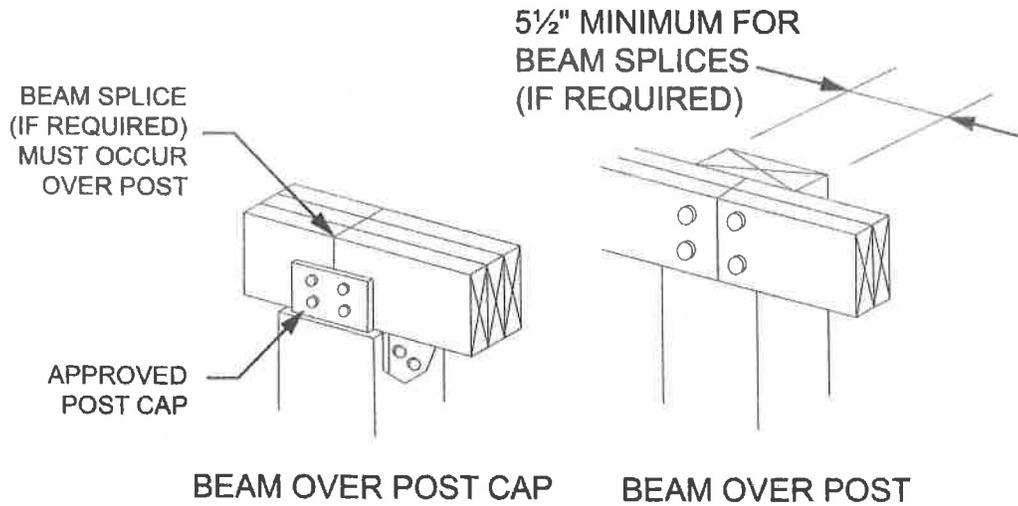

For SI: 1 inch = 25.4 mm.


**FIGURE R507.5.1(1)**  
**DECK BEAM TO DECK POST**

FLOORS

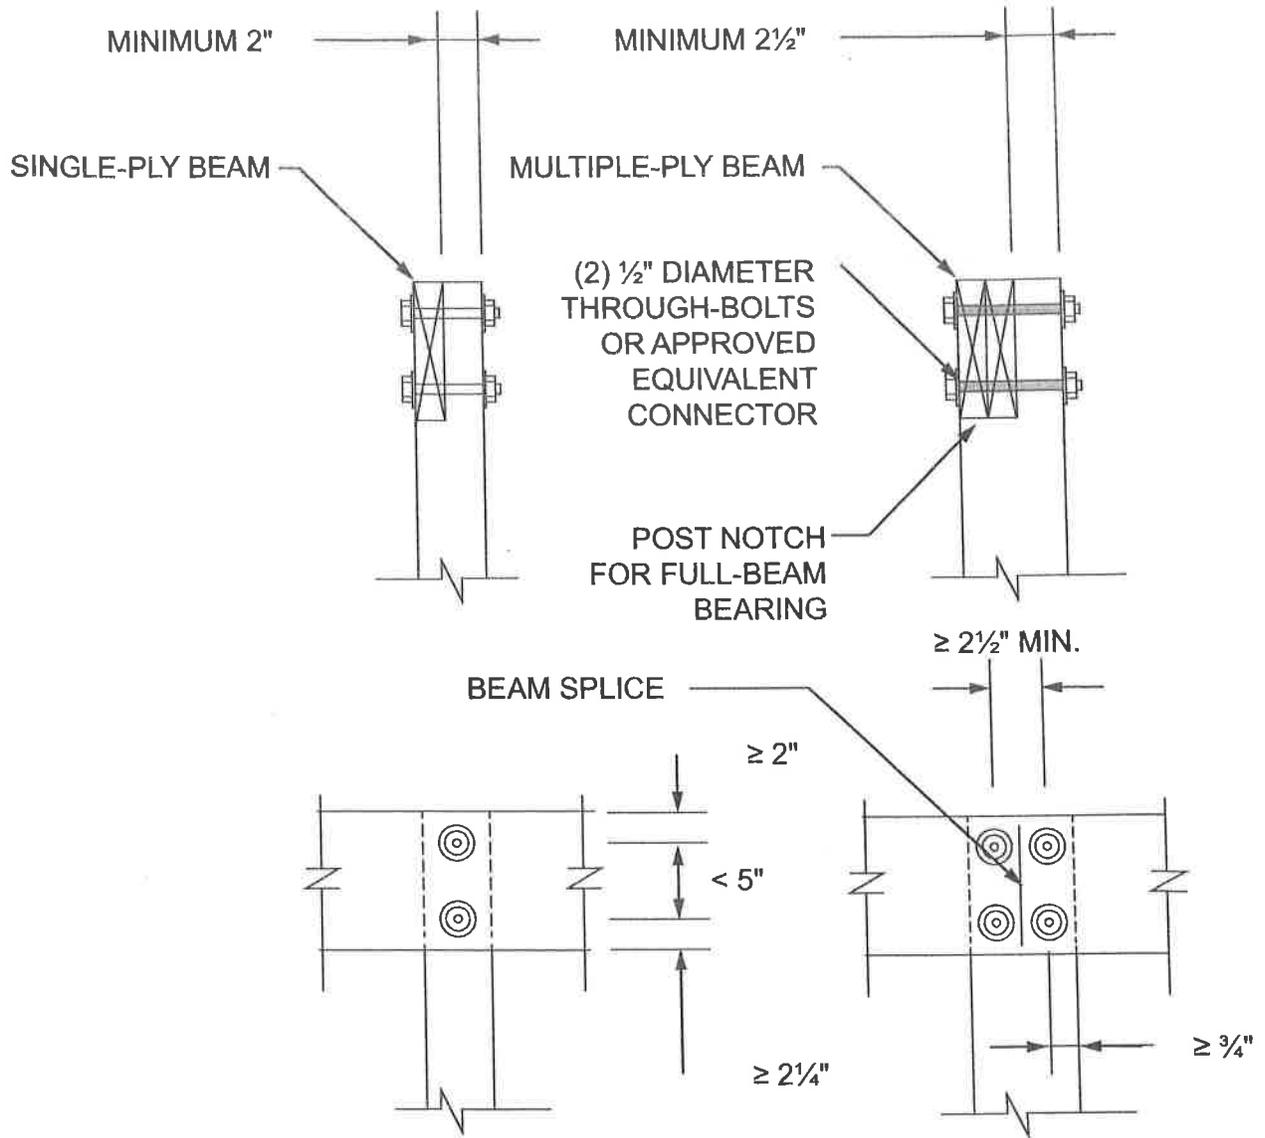


For SI: 1 inch = 25.4 mm.


FIGURE R507.5.1(2)  
NOTCHED POST-TO-BEAM CONNECTION

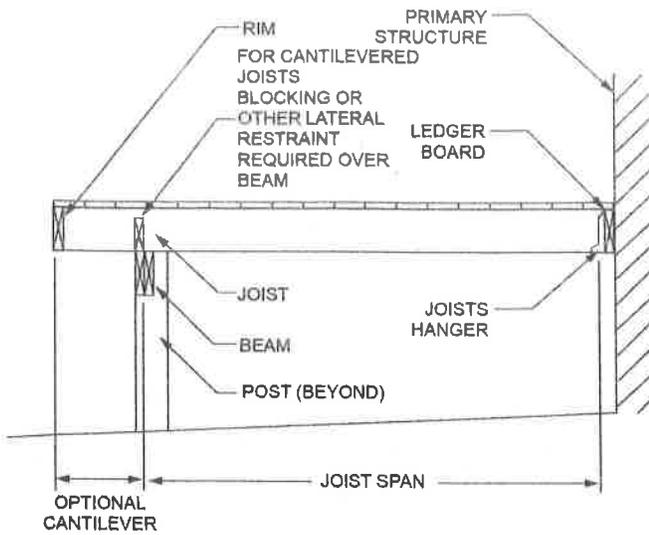


CANTILEVERED JOISTS WITH DROPPED BEAM

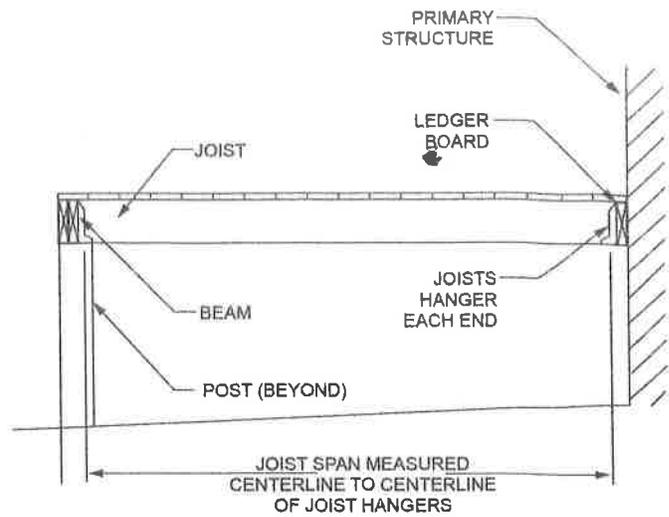

JOISTS WITH FLUSH BEAM

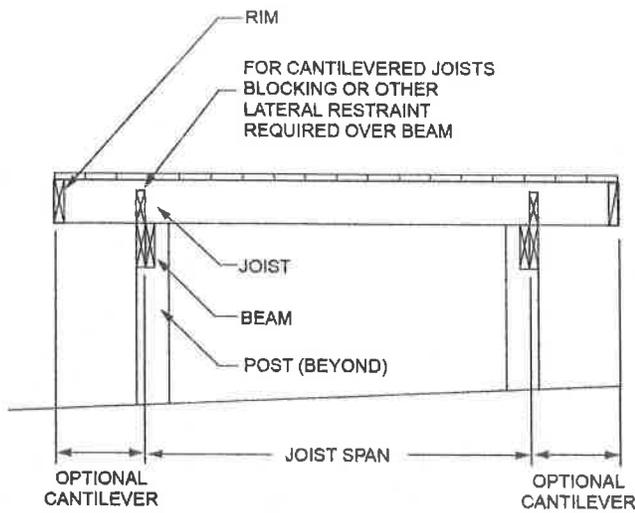

JOISTS ON FREE-STANDING DECK WITH DROPPED BEAM

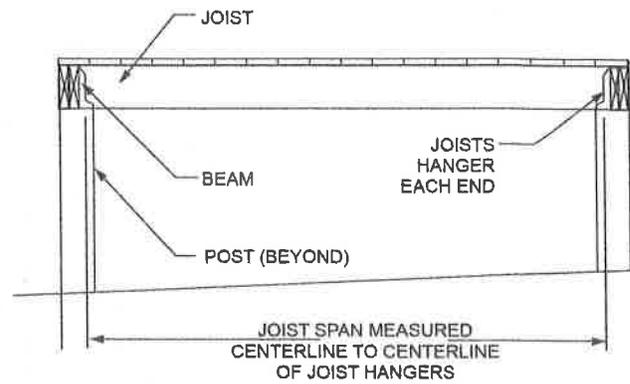

JOISTS ON FREE-STANDING DECK WITH FLUSH BEAM

FIGURE R507.6  
TYPICAL DECK JOIST SPANS

FLOORS

TABLE R507.6  
MAXIMUM DECK JOIST SPANS

LOAD <sup>a</sup> (psf)	JOIST SPECIES <sup>b</sup>	JOIST SIZE	ALLOWABLE JOIST SPAN <sup>b, c</sup> (feet-inches)			MAXIMUM CANTILEVER <sup>d, f</sup> (feet-inches)							
			Joist spacing (inches)			Joist back span <sup>d</sup> (feet)							
			12	16	24	4	6	8	10	12	14	16	18
40 live load	Southern pine	2 x 6	9-11	9-0	7-7	1-0	1-6	1-5	NP	NP	NP	NP	NP
		2 x 8	13-1	11-10	9-8	1-0	1-6	2-0	2-6	2-3	NP	NP	NP
		2 x 10	16-2	14-0	11-5	1-0	1-6	2-0	2-6	3-0	3-4	3-4	NP
		2 x 12	18-0	16-6	13-6	1-0	1-6	2-0	2-6	3-0	3-6	4-0	4-1
	Douglas fir-larch <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	2 x 6	9-6	8-4	6-10	1-0	1-6	1-4	NP	NP	NP	NP	NP
		2 x 8	12-6	11-1	9-1	1-0	1-6	2-0	2-3	2-0	NP	NP	NP
		2 x 10	15-8	13-7	11-1	1-0	1-6	2-0	2-6	3-0	3-3	NP	NP
		2 x 12	18-0	15-9	12-10	1-0	1-6	2-0	2-6	3-0	3-6	3-11	3-11
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	2 x 6	8-10	8-0	6-10	1-0	1-4	1-1	NP	NP	NP	NP	NP
		2 x 8	11-8	10-7	8-8	1-0	1-6	2-0	1-11	NP	NP	NP	NP
		2 x 10	14-11	13-0	10-7	1-0	1-6	2-0	2-6	3-0	2-9	NP	NP
		2 x 12	17-5	15-1	12-4	1-0	1-6	2-0	2-6	3-0	3-6	3-8	NP
50 ground snow load	Southern pine	2 x 6	9-2	8-4	7-4	1-0	1-6	1-5	NP	NP	NP	NP	NP
		2 x 8	12-1	11-0	9-5	1-0	1-6	2-0	2-5	2-3	NP	NP	NP
		2 x 10	15-5	13-9	11-3	1-0	1-6	2-0	2-6	3-0	3-1	NP	NP
		2 x 12	18-0	16-2	13-2	1-0	1-6	2-0	2-6	3-0	3-6	3-10	3-10
	Douglas fir-larch <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	2 x 6	8-10	8-0	6-8	1-0	1-6	1-4	NP	NP	NP	NP	NP
		2 x 8	11-7	10-7	8-11	1-0	1-6	2-0	2-3	NP	NP	NP	NP
		2 x 10	14-10	13-3	10-10	1-0	1-6	2-0	2-6	3-0	3-0	NP	NP
		2 x 12	17-9	15-5	12-7	1-0	1-6	2-0	2-6	3-0	3-6	3-8	NP
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	2 x 6	8-3	7-6	6-6	1-0	1-4	1-1	NP	NP	NP	NP	NP
		2 x 8	10-10	9-10	8-6	1-0	1-6	2-0	1-11	NP	NP	NP	NP
		2 x 10	13-10	12-7	10-5	1-0	1-6	2-0	2-6	2-9	NP	NP	NP
		2 x 12	16-10	14-9	12-1	1-0	1-6	2-0	2-6	3-0	3-5	3-5	NP
60 ground snow load	Southern pine	2 x 6	8-8	7-10	6-10	1-0	1-6	1-5	NP	NP	NP	NP	NP
		2 x 8	11-5	10-4	8-9	1-0	1-6	2-0	2-4	NP	NP	NP	NP
		2 x 10	14-7	12-9	10-5	1-0	1-6	2-0	2-6	2-11	2-11	NP	NP
		2 x 12	17-3	15-0	12-3	1-0	1-6	2-0	2-6	3-0	3-6	3-7	NP
	Douglas fir-larch <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	2 x 6	8-4	7-6	6-2	1-0	1-6	1-4	NP	NP	NP	NP	NP
		2 x 8	10-11	9-11	8-3	1-0	1-6	2-0	2-2	NP	NP	NP	NP
		2 x 10	13-11	12-4	10-0	1-0	1-6	2-0	2-6	2-10	NP	NP	NP
		2 x 12	16-6	14-3	11-8	1-0	1-6	2-0	2-6	3-0	3-5	3-5	NP
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	2 x 6	7-9	7-0	6-2	1-0	1-4	NP	NP	NP	NP	NP	NP
		2 x 8	10-2	9-3	7-11	1-0	1-6	2-0	1-11	NP	NP	NP	NP
		2 x 10	13-0	11-9	9-7	1-0	1-6	2-0	2-6	2-7	NP	NP	NP
		2 x 12	15-9	13-8	11-2	1-0	1-6	2-0	2-6	3-0	3-2	NP	NP

(continued)

**TABLE R507.6—continued  
MAXIMUM DECK JOIST SPANS**

LOAD <sup>a</sup> (psf)	JOIST SPECIES <sup>b</sup>	JOIST SIZE	ALLOWABLE JOIST SPAN <sup>b, c</sup> (feet-inches)			MAXIMUM CANTILEVER <sup>d, f</sup> (feet-inches)							
			Joist spacing (Inches)			Joist back span <sup>g</sup> (feet)							
			12	16	24	4	6	8	10	12	14	16	18
70 ground snow load	Southern pine	2 × 6	8-3	7-6	6-5	1-0	1-6	1-5	NP	NP	NP	NP	NP
		2 × 8	10-10	9-10	8-2	1-0	1-6	2-0	2-2	NP	NP	NP	NP
		2 × 10	13-9	11-11	9-9	1-0	1-6	2-0	2-6	2-9	NP	NP	NP
		2 × 12	16-2	14-0	11-5	1-0	1-6	2-0	2-6	3-0	3-5	3-5	NP
	Douglas fir-larch <sup>e</sup> Hem-fir <sup>e</sup> Spruce-pine-fir <sup>e</sup>	2 × 6	7-11	7-1	5-9	1-0	1-6	NP	NP	NP	NP	NP	NP
		2 × 8	10-5	9-5	7-8	1-0	1-6	2-0	2-1	NP	NP	NP	NP
		2 × 10	13-3	11-6	9-5	1-0	1-6	2-0	2-6	2-8	NP	NP	NP
	Redwood <sup>f</sup> Western cedars <sup>f</sup> Ponderosa pine <sup>f</sup> Red pine <sup>f</sup>	2 × 12	15-5	13-4	10-11	1-0	1-6	2-0	2-6	3-0	3-3	NP	NP
		2 × 6	7-4	6-8	5-10	1-0	1-4	NP	NP	NP	NP	NP	NP
		2 × 8	9-8	8-10	7-4	1-0	1-6	1-11	NP	NP	NP	NP	NP
		2 × 10	12-4	11-0	9-0	1-0	1-6	2-0	2-6	2-6	NP	NP	NP
			2 × 12	14-9	12-9	10-5	1-0	1-6	2-0	2-6	3-0	3-0	NP

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa, 1 pound = 0.454 kg.

NP = Not Permitted.

- a. Dead load = 10 psf. Snow load not assumed to be concurrent with live load.
- b. No. 2 grade, wet service factor included.
- c.  $L/\Delta = 360$  at main span.
- d.  $L/\Delta = 180$  at cantilever with a 220-pound point load applied to end.
- e. Includes incising factor.
- f. Incising factor not included.
- g. Interpolation allowed. Extrapolation is not allowed.

**TABLE R507.7  
MAXIMUM JOIST SPACING FOR WOOD DECKING**

DECKING MATERIAL TYPE AND NOMINAL SIZE	DECKING PERPENDICULAR TO JOIST		DECKING DIAGONAL TO JOIST <sup>a</sup>	
	Single span <sup>c</sup>	Multiple span <sup>c</sup>	Single span <sup>c</sup>	Multiple span <sup>c</sup>
	Maximum on-center joist spacing (Inches)			
1 <sup>1</sup> / <sub>4</sub> -inch-thick wood <sup>b</sup>	12	16	8	12
2-inch-thick wood	24	24	18	24

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 degree = 0.01745 rad.

- a. Maximum angle of 45 degrees from perpendicular for wood deck boards.
- b. Other maximum span provided by an accredited lumber grading or inspection agency also allowed.
- c. Individual wood deck boards supported by two joists shall be considered single span and three or more joists shall be considered multiple span.

FLOORS

TABLE R507.9.1.3(1)  
DECK LEDGER CONNECTION TO BAND JOIST

LOAD <sup>a</sup> (psf)	JOIST SPAN <sup>a</sup> (feet)	ON-CENTER SPACING OF FASTENERS <sup>b</sup> (inches)		
		1/2-inch diameter lag screw with 1/2-inch maximum sheathing <sup>d, e</sup>	1/2-inch diameter bolt with 1/2-inch maximum sheathing <sup>e</sup>	1/2-inch diameter bolt with 1-inch maximum sheathing <sup>f</sup>
40 live load	6	30	36	36
	8	23	36	36
	10	18	34	29
	12	15	29	24
	14	13	24	21
	16	11	21	18
	18	10	19	16
50 ground snow load	6	29	36	36
	8	22	36	35
	10	17	33	28
	12	14	27	23
	14	12	23	20
	16	11	20	17
	18	9	18	15
60 ground snow load	6	25	36	36
	8	18	35	30
	10	15	28	24
	12	12	23	20
	14	10	20	17
	16	9	17	15
	18	8	15	13
70 ground snow load	6	22	36	35
	8	16	31	26
	10	13	25	21
	12	11	20	17
	14	9	17	15
	16	8	15	13
	18	7	13	11

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 pound per square foot = 0.0479 kPa.


- a. Interpolation permitted. Extrapolation is not permitted.
- b. Ledgers shall be flashed in accordance with Section R703.4 to prevent water from contacting the house band joist.
- c. Dead Load = 10 psf. Snow load shall not be assumed to act concurrently with live load.
- d. The tip of the lag screw shall fully extend beyond the inside face of the band joist.
- e. Sheathing shall be wood structural panel or solid sawn lumber.
- f. Sheathing shall be permitted to be wood structural panel, gypsum board, fiberboard, lumber or foam sheathing. Up to 1/2-inch thickness of stacked washers shall be permitted to substitute for up to 1/2 inch of allowable sheathing thickness where combined with wood structural panel or lumber sheathing.

**TABLE R507.9.1.3(2)**  
**PLACEMENT OF LAG SCREWS AND BOLTS IN DECK LEDGERS AND BAND JOISTS**

MINIMUM END AND EDGE DISTANCES AND SPACING BETWEEN ROWS				
	TOP EDGE	BOTTOM EDGE	ENDS	ROW SPACING
Ledger <sup>a</sup>	2 inches <sup>d</sup>	3/4 inch	2 inches <sup>b</sup>	1 5/8 inches <sup>b</sup>
Band Joist <sup>c</sup>	3/4 inch	2 inches	2 inches <sup>b</sup>	1 5/8 inches <sup>b</sup>


For SI: 1 inch = 25.4 mm.

- a. Lag screws or bolts shall be staggered from the top to the bottom along the horizontal run of the deck ledger in accordance with Figure R507.9.1.3(1).
- b. Maximum 5 inches.
- c. For engineered rim joists, the manufacturer's recommendations shall govern.
- d. The minimum distance from bottom row of lag screws or bolts to the top edge of the ledger shall be in accordance with Figure R507.9.1.3(1).

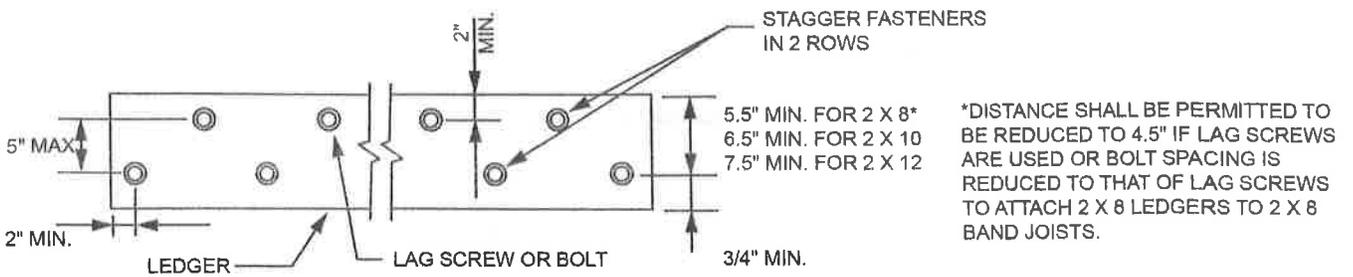

For SI: 1 inch = 25.4 mm.

**FIGURE R507.9.1.3(1)**  
**PLACEMENT OF LAG SCREWS AND BOLTS IN LEDGERS**

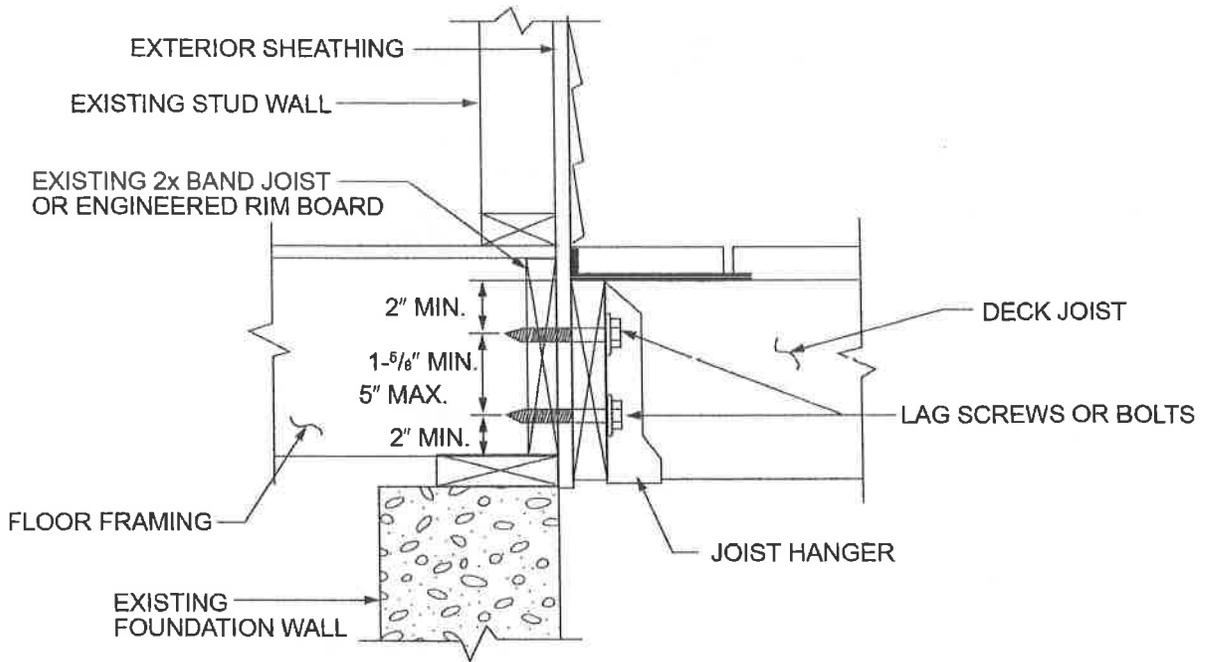


For SI: 1 inch = 25.4 mm.

**FIGURE R507.9.1.3(2)**  
**PLACEMENT OF LAG SCREWS AND BOLTS IN BAND JOISTS**

**FLOORS**


**R507.9.2 Lateral connection.** Lateral loads shall be transferred to the ground or to a structure capable of transmitting them to the ground. Where the lateral load connection is provided in accordance with Figure R507.9.2(1), hold-down tension devices shall be installed in not less than two locations per deck, within 24 inches (610 mm) of each end of the deck. Each device shall have

an allowable stress design capacity of not less than 1,500 pounds (6672 N). Where the lateral load connections are provided in accordance with Figure R507.9.2(2), the hold-down tension devices shall be installed in not less than four locations per deck, and each device shall have an allowable stress design capacity of not less than 750 pounds (3336 N).

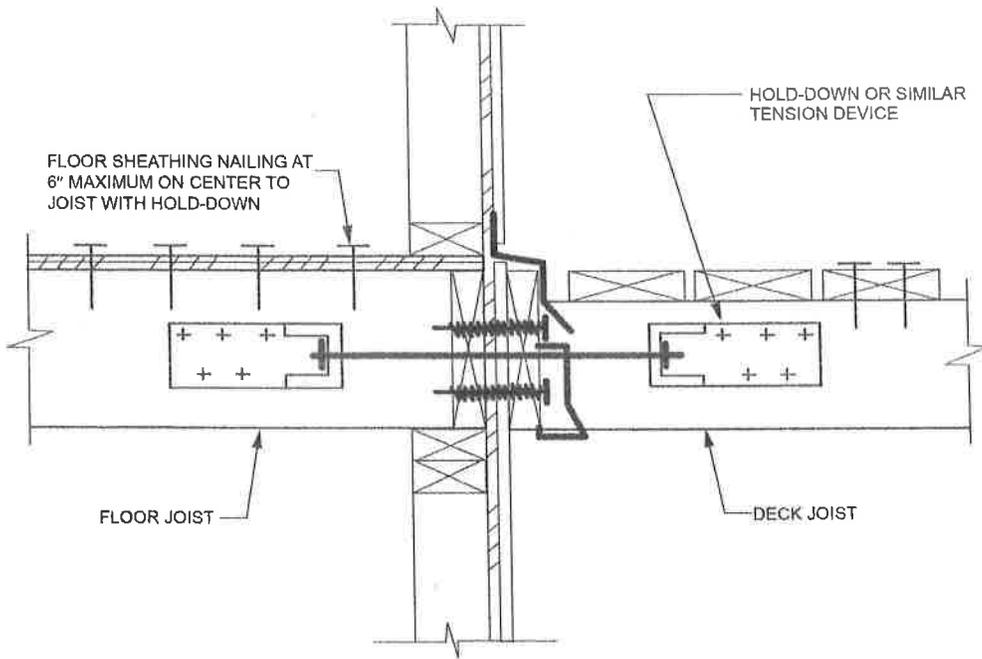

For SI: 1 inch = 25.4 mm.

**FIGURE R507.9.2(1)  
DECK ATTACHMENT FOR LATERAL LOADS**

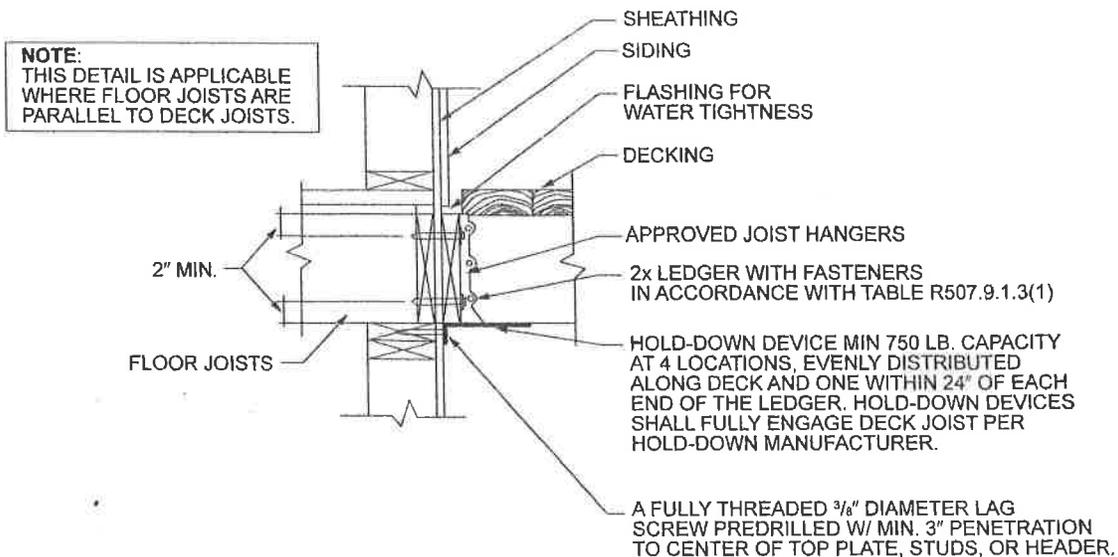

**NOTE:**  
THIS DETAIL IS APPLICABLE  
WHERE FLOOR JOISTS ARE  
PARALLEL TO DECK JOISTS.

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

**FIGURE R507.9.2(2)  
DECK ATTACHMENT FOR LATERAL LOADS**

**R507.10 Exterior guards.** *Guards* shall be constructed to meet the requirements of Sections R301.5 and R312, and this section.

**R507.10.1 Support of guards.** Where *guards* are supported on deck framing, *guard* loads shall be transferred to the deck framing with a continuous load path to the deck joists.

**R507.10.1.1 Guards supported by side of deck framing.** Where *guards* are connected to the interior or exterior side of a deck joist or beam, the joist or beam shall be connected to the adjacent joists to prevent rotation of the joist or beam. Connections relying only on fasteners in end grain withdrawal are not permitted.

**R507.10.1.2 Guards supported on top of deck framing.** Where *guards* are mounted on top of the decking, the *guards* shall be connected to the deck framing or blocking and installed in accordance with manufacturer's instructions to transfer the *guard* loads to the adjacent joists.

**R507.10.2 Wood posts at deck guards.** Where 4-inch by 4-inch (102 mm by 102 mm) wood posts support guard loads applied to the top of the guard, such posts shall not be notched at the connection to the supporting structure.

**R507.10.3 Plastic composite guards.** *Plastic composite guards* shall comply with the provisions of Section R507.2.2.

**R507.10.4 Other guards.** Other *guards* shall be in accordance with either manufacturer's instructions or accepted engineering principles.

# LedgerLOK<sup>®</sup>

## Structural Wood Screw

LedgerLOK is a code-compliant structural wood screw engineered to fasten a deck ledger board to the rim joist of a house with no predrilling. LedgerLOK replaces lag screws and through-bolts, has been coated with a proprietary three-step coating process that protects against corrosion (even in pressure treated wood) and is ACQ approved.

The built-in washer head eliminates the need for an additional washer, saving time and money.

The large hex-head allows for greater bit engagement, reducing cam-out. [\(isotope/i/ledgerlok-358.jpg\)](#)



.OK technical information and drawings, see the Technical Docs section below. For documentation of all our structural wood screws, see our [Technical Resources page](#).

[.html](#)

[\(isotope/i/id-1\\_ledgerlohexheadwshaft.jpg\)](#)




[\(isotope/i/id-2\\_ledgerlok-pkgswithclams.jpg\)](#)



[\(isotope/i/id-3\\_ledgerusagerev.jpg\)](#)



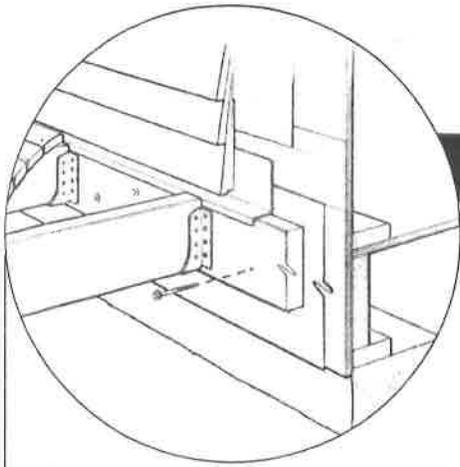

FastenMaster  
**LedgerLOK**  
Ledger Board Fastener

## DECK LEDGER TO RIM JOIST

### CONNECTION DETAILS

The LedgerLOK Ledger Board Fastener has been designed specifically for attaching the deck ledger to a rim joist or band board of the house in a code compliant manner. When installed as instructed in this bulletin, the LedgerLOK can be used to replace the 1/2" Lag Screws called for in Table 502.2.2.1 of the 2009 International Residential Code (IRC) or Table 507.2 of the 2012 IRC.

In addition, the proprietary coating on this fastener exceeds the corrosion protection provided by code approved hot-dipped galvanized coatings.

### INSTALLATION PROCEDURES

- Choose 3-5/8" or 5" LedgerLOK so that threads fully engage the rim material and fastener tip extends beyond the inside face of the rim joist.
- Use a high torque, 1/2" variable speed drill (18V if cordless).
- Follow the minimum spacing and fastening patterns from Figure 1 and Table 1.
- Install fasteners through the ledger and sheathing. Continue into the rim joist until the washer head is drawn firm and flush to the ledger board. Do not overdrive.

### CORROSION STATEMENT

The proprietary galvanized and polymer coating applied to the LedgerLOK has been tested under the current ICC standard for evaluating corrosion resistance in treated lumber (AC257) and deemed suitable alternative to code-approved hot-dipped galvanized coatings when exposed to ground contact ACQ preservative treatment in wet-use conditions. A statement of this compliance can be found in the ICC Evaluation Report for LedgerLOK (ESR #1078), available online at [icc-es.org](http://icc-es.org) or the FastenMaster website.

For applications within 1,000 feet of saltwater, we recommend the use of a stainless steel fastener.

### SPACING REQUIREMENTS

Fasteners should be staggered in a "V" pattern and spaced as follows:

- Minimum end distance = 3-3/4"
- Minimum edge distance = 1-3/4"
- On-center spacing = Per Table 1

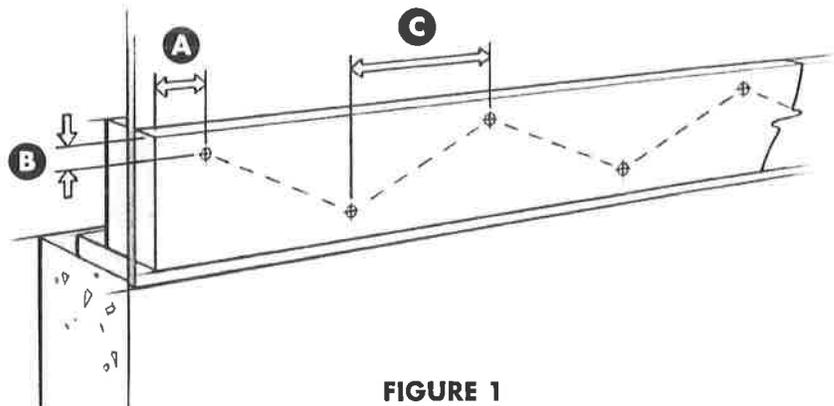


FIGURE 1

**FastenMaster**  
FASTER EASIER STRONGER

Effective July 1, 2014. Please reference our website to ensure that you are using the most up to date version.

153 BOWLES ROAD, AGAWAM, MA 01001

413-789-0252

800-518-3569

[WWW.FASTENMASTER.COM](http://WWW.FASTENMASTER.COM)

**FASTENING PATTERN**

Determine the proper spacing of LedgerLOK fasteners from Table 1 below based on:

- Live load requirement for your local code
- Ledger material being attached to the house
- Rim material that you are attaching to
- Joist span as measured from the ledger to the first supporting beam

**TABLE 1: Fastening pattern for attachment of ledger to rim board using LedgerLOK**

Live Load	Ledger Material	Rim Material	Spacing between fasteners (in inches) based on Joist Spans of:						
			6' or Less	Up to 8'	Up to 10'	Up to 12'	Up to 14'	Up to 16'	Up to 18'
40 psf	Doug. Fir or S. Pine	2x Lumber	24	18	14	12	10	9	8
		EW Rim	25	19	15	12	10	9	8
	Hem Fir	2x Lumber	20	15	12	10	8	7	6
		EW Rim	25	19	15	12	10	9	8
60 psf	Doug. Fir or S. Pine	2x Lumber	17	13	10	8	7	6	5
		EW Rim	18	13	10	9	7	6	6
	Hem Fir	2x Lumber	14	11	8	7	6	5	4
		EW Rim	18	13	10	9	7	6	6

LedgerLOK fastening patterns outlined in this table provide equal or better performance to lag screw patterns in the 2009 and 2012 IRC in accordance with IRC sections R104.11 and in accordance with generally accepted engineering practice. Design values used to create these patterns were derived from individual fastener testing under ICC Acceptance Criteria AC233 (ESR #1078) as well as full system testing directly comparing lag screw and LedgerLOK performance in ledger to rim connections using generally accepted industry standards used to generate the IRC fastener spacing tables for lag screws.

- **Ledger materials** must be a minimum of 2 x 8 nominal dimensional pressure-preservative-treated No. 2 lumber from any of the following species: Hem-Fir, SPF, Douglas Fir or Southern Pine.
- **Rim joist materials** must be either solid sawn 2x lumber or engineered wood specifically designated by the manufacturer as rim material. 2x lumber may be of any species greater than 0.42 specific gravity, including SPF, HF or DF. Engineered Wood (EW) Rim may be OSB, LSL or LVL material measuring 1" or greater in thickness.
- **Sheathing** of 15/32" or 7/16" OSB may separate the ledger and rim but must be attached per code. For additional materials between ledger and rim, please refer to the guidelines below.

Wet service conditions have been tested for and applied to the patterns above. **No further reductions for wet service need to be applied.**

The code-standard dead load for building materials of 10 pounds per square foot is assumed in all calculations above.

As required by IRC Section 502.2.2.2, the calculations and installation instructions found in this bulletin have been reviewed and found to be in accordance with accepted engineering practices. For a copy of the engineer stamped/sealed letter or further technical information to support this bulletin, please contact FastenMaster at 800-518-3569.

**GENERAL FASTENING GUIDELINES**


- The LedgerLOK is not designed for attachment to masonry/concrete or over stucco, siding, rigid foam insulation or brick veneer.
- Connections and joints shall be properly flashed to prevent water from contacting the rim joist.
- Where a positive connection to the rim joist cannot be verified through inspection, decks shall be self supporting.
- Ledgers should not be attached over cantilevered portions of the house where the rim is unsupported by a foundation.
- For ledgers being attached to open web floor trusses, consult "Attachment of Residential Deck Ledger to Metal Plate Connected Wood Truss Floor System" published by the Structural Building Component Association for proper design methods. This Technical Note can be found at [www.sbcindustry.com](http://www.sbcindustry.com).
- Wood structural panel sheathing or gypsum board sheathing not exceeding 1" in thickness shall be permitted provided that the maximum distance between the inner face of the ledger board and the outer face of the rim joist is no greater than 1" and is properly fastened to the rim.
- Under the following conditions, the LedgerLOK may still be approved but a design professional should be consulted for proper spacing requirements:
  1. In areas where live load requirements exceed 60 psf or snow load requirements exceed 70 psf.
  2. For decks designed to carry increased dead loads (ex: hot tubs, stationary planters).
  3. Three-season or fully enclosed decks supporting an overhead roof.
- All local code requirements as well as guidelines set forth in this technical bulletin must be followed for patterns outlined above to be applicable.

**GUARD REQUIREMENTS**

All decks greater than 30" above grade are required to have a guard [R312.1] - one example is shown in Figure 24. Other methods and materials may be used for guard

construction when *approved* by the authority having jurisdiction.

**Figure 24. Example Guard Detail.**

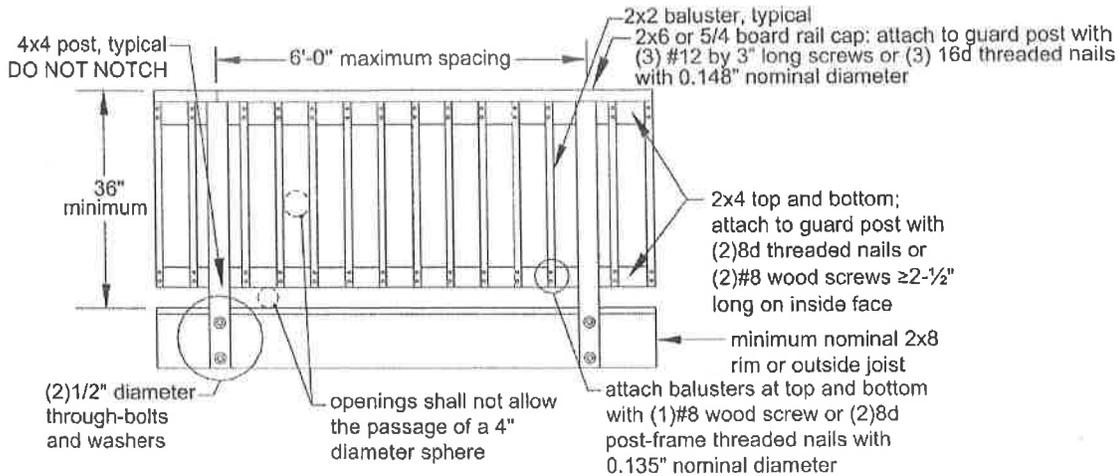

**GUARD POST ATTACHMENTS FOR REQUIRED GUARDS**

Deck guard posts for required guards shall be a minimum 4x4 (nominal) with an adjusted bending design value not less than 1,100 psi. Joists and rim joists to which guard posts are attached shall be a minimum of 2x8 (nominal).

Figure 25. Guard posts for required guards that run perpendicular to the deck joists shall be attached to the rim joist in accordance with Figure 26. Only hold-down anchor models meeting these minimum requirements shall be used. Hold-down anchors shall have a minimum allowable tension load of 1,800 pounds for a 36" maximum guard height and be installed in accordance with the manufacturer's instructions.

Guard posts for required guards which run parallel to the deck joists shall be attached to the outside joist per

**Figure 25. Guard Post to Outside-Joist Example.**


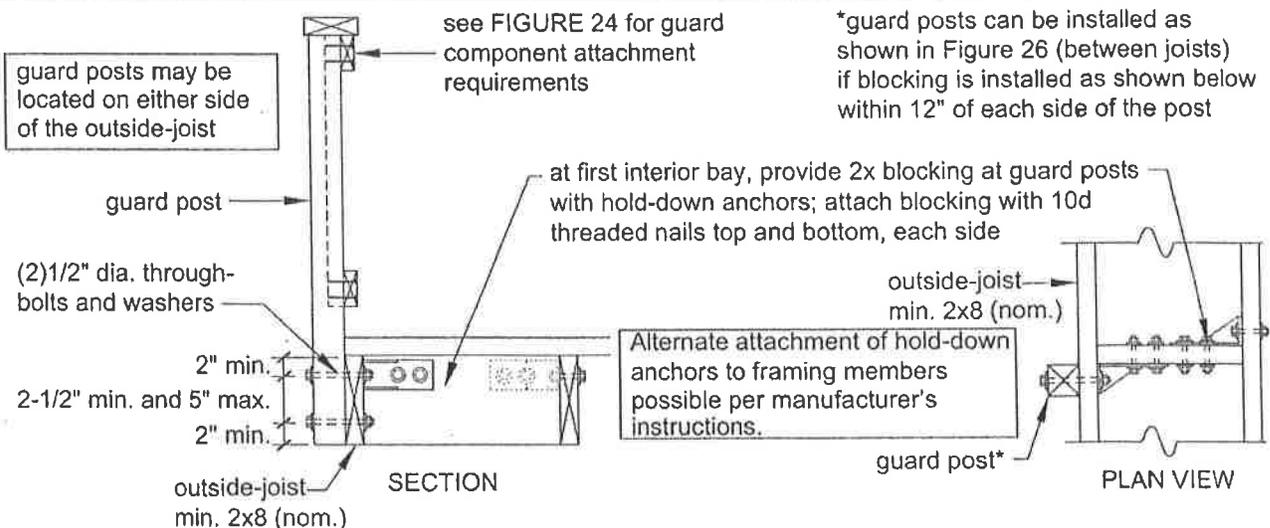



Figure 26. Guard Post to Rim Joist Example.

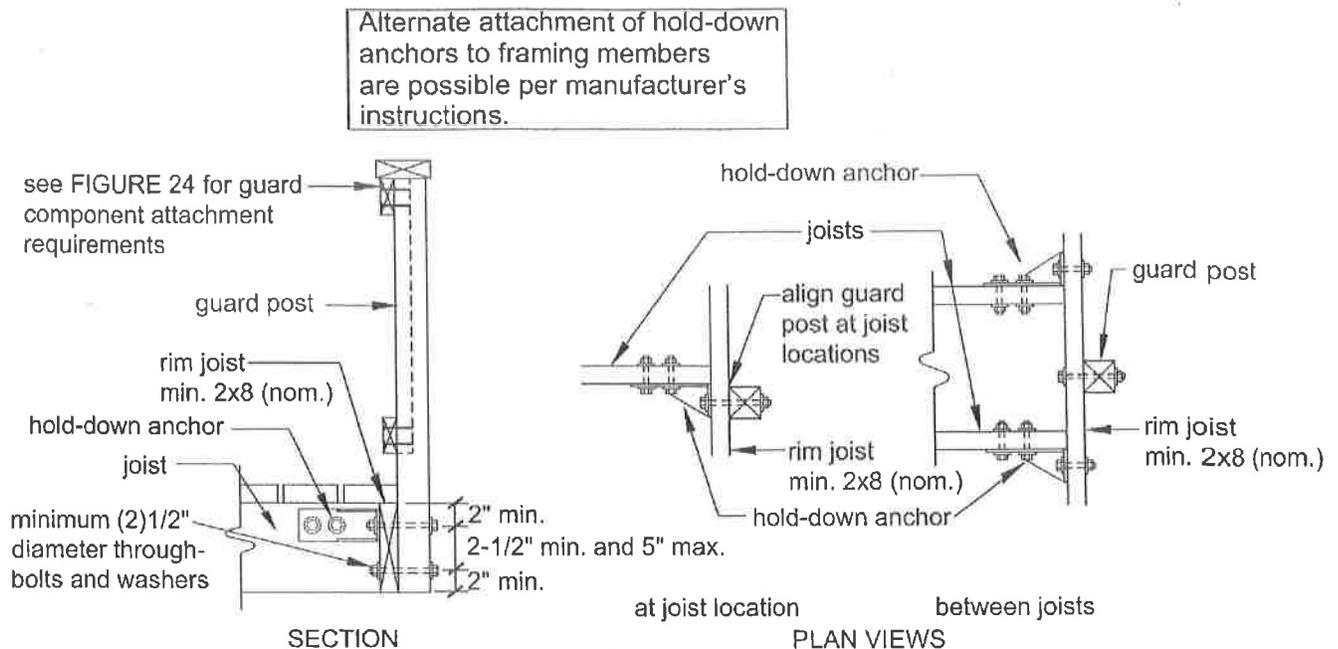


### STAIR REQUIREMENTS

Stairs, stair stringers, and stair guards shall meet the requirements shown in Figure 27 through Figure 34 and Table 6 except where amended by the local jurisdiction. All stringers shall be a minimum of 2x12. Stair stringers shall not span more than the dimensions shown in Figure 28. If the stringer span exceeds these dimensions, then a 4x4 post may be provided to support the stringer and shorten its span length. The 4x4 post shall be notched and bolted to the stringer with (2) 1/2" diameter through-bolts with washers per Figure 8A. The post shall be centered on a 12" diameter or 10" square, 6" thick footing. The footing shall be constructed as shown in Figure 34 and attached to the post as shown in Figure 12. An intermediate landing may also be provided to shorten the stringer span (see provisions below). If the total vertical height of a stairway exceeds 12'-0", then an intermediate landing shall be required. All intermediate stair landings must be designed and constructed as a non-ledger deck using the details in this document. Stairs shall be a minimum of 36" in width as shown in Figure 33 [R311.7]. If only cut stringers are used, a minimum of three are required. For stairs greater than 36" in width, a combination of cut and solid stringers can be used, but shall be placed at a maximum spacing of 18" on center (see Figure 29). The width of each landing shall not be less than the width of the stairway served. Every rectangular landing shall have a minimum dimension of 36" measured in the direction of travel and no less than the width of the stairway served [R311.7].


Figure 27. Tread and Riser Detail.

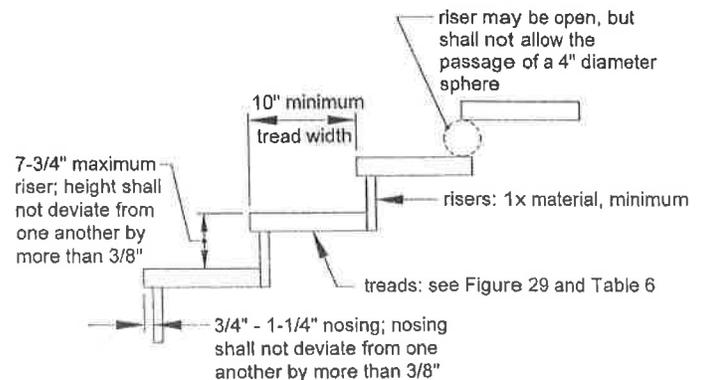

**Figure 28. Stair Stringer Requirements.**

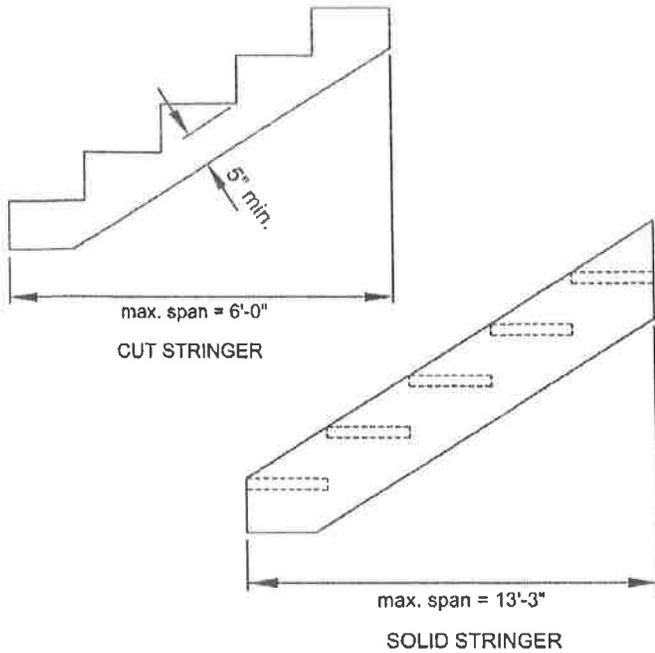


**Figure 30. Stair Guard Requirements.**

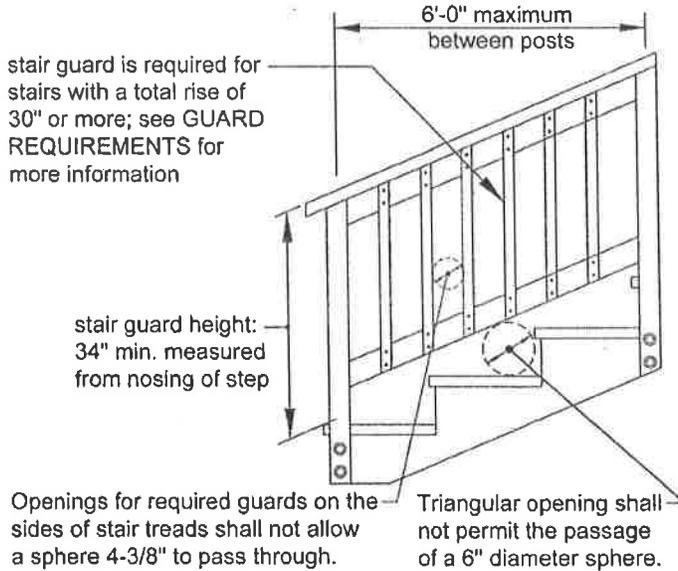


**Figure 29. Tread Connection Requirements.**

Attachment per tread at each stringer or ledger:  
 2x\_ or 5/4 treads - (2)#8 threaded nails or (2)#8 screws  $\geq 2\text{-}1/2"$  long  
 3x\_ treads - (2)#16d threaded nails or (2)#8 screws  $\geq 3\text{-}1/2"$  long

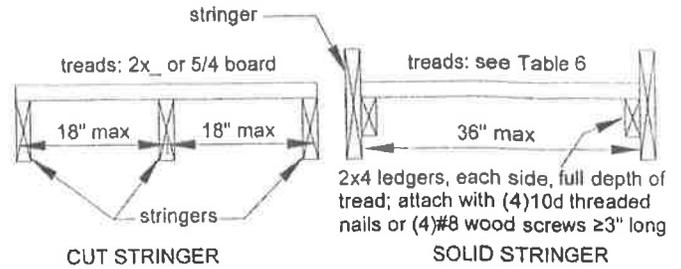

**Figure 31. Stair Stringer Attachment Detail.**

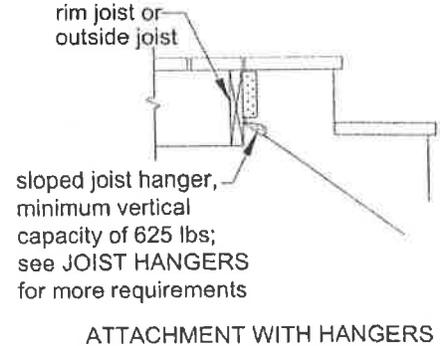

**Table 6. Minimum Tread Size for Cut and Solid Stringers.<sup>1</sup>**

Species	Cut Stringer	Solid Stringer
Southern Pine	2x4 or 5/4	2x8
Douglas Fir Larch, Hem-Fir, SPF <sup>2</sup>	2x4 or 5/4	2x8 or 3x4
Redwood, Western Cedars, Ponderosa Pine, <sup>3</sup> Red Pine <sup>3</sup>	2x4 or 5/4	2x10 or 3x4

1. Assumes 300 lb concentrated load, L/288 deflection limit, No. 2 stress grade, and wet service conditions.


2. Incising assumed for Douglas Fir-Larch, Hem-Fir, and Spruce-Pine-Fir.

3. Design values based on northern species with no incising assumed.


**STAIR HANDRAIL REQUIREMENTS**

All stairs with 4 or more risers shall have a handrail on at least one side (see Figure 32A) [R311.7.8]. The handrail height measured vertically from the sloped plane adjoining the tread nosing shall be not less than 34 inches and not more than 38 inches (see Figure 30) [R311.7.8.1]. Handrails shall be graspable and shall be composed of decay-resistant and/or corrosion resistant material. Handrails shall be Type I, Type II, or provide equivalent graspability (see Figure 32B). Type I shall have a perimeter dimension of at least 4" and not greater than 6-1/4". Type II rails with a perimeter greater than 6-1/4" shall provide a graspable finger recess area on both sides of the profile [R311.7.8.3]. All shapes shall have a smooth surface with no sharp corners. Handrails shall run continuously from a point directly over the lowest riser to a point directly over the highest riser and shall return to the guard at each end (see Figure 33). Handrails may be interrupted by guard posts at a turn in the stair [R311.7.8.2].

**Figure 32A. Handrail Mounting Examples.**

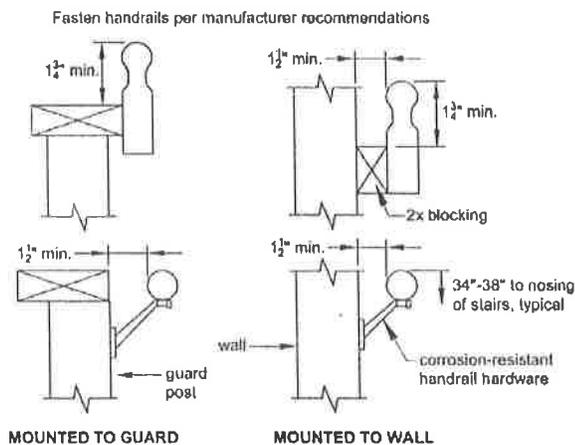

**Figure 32B. Handrail Grip Size.**

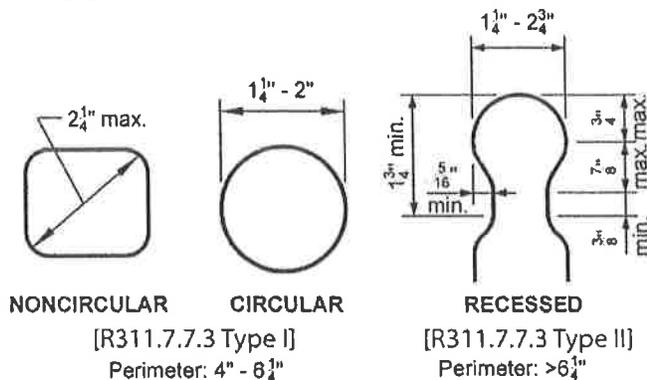


**STAIR FOOTING REQUIREMENTS [R403]**

Where the stairway meets grade, attach the stringers to the stair guard posts as shown in Figure 34. Posts shall bear on footings. All footings shall bear on solid ground and shall be placed at least 12 inches below the undisturbed ground surface or below the frost line, whichever is deeper (see Figure 34). Stringers shall bear on a 2x4 bearing block attached to the post as shown. Stringers shall not bear on new or existing concrete pads or patios that are not founded below this depth. When guards are not required (see **GUARD REQUIREMENTS**), posts may terminate below the bottom tread elevation. Bolts are only required if a guard post is required.

**STAIR LIGHTING REQUIREMENTS [R303.7]**

Stairways shall have a light source located at the top landing such that all stairs and landings are illuminated. The light switch shall be operated from inside the house. However, motion detected or timed switches are acceptable.

**Figure 33. Miscellaneous Stair Requirements.**

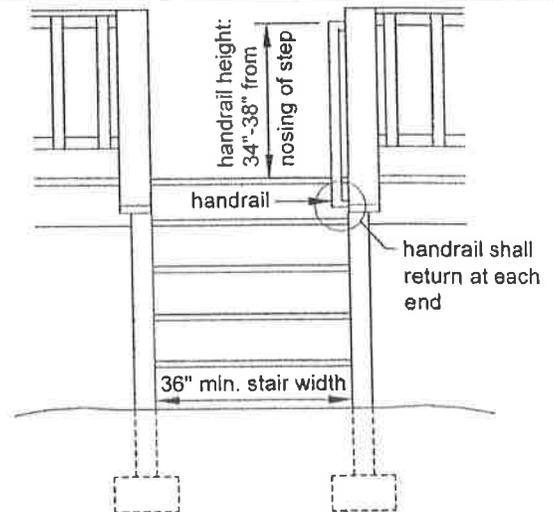

**Figure 34. Stair Footing Detail.**

